

END-SUCTION CENTRIFUGAL PUMPS

Series: IA

2 - 125 HP / 1750 & 3500 RPM

Suction: 1½" - 8" NPT or flange

Discharge: 1" - 6" NPT or flange



Representative images

APPLICATIONS

- ▶ Booster systems
- ▶ Water transfer
- ▶ Chilled water system
- ▶ High flow-rate / medium pressure

VOLUTE

Cast iron ASTM A-48 class 30

LIQUID TEMPERATURE

160 °F (71 °C) max.

INTERMEDIATE COUPLING

Cast iron ASTM A-48 class 30

IMPELLER

- ▶ Cast iron ASTM A-48 class 30
- ▶ Dynamically balanced

SEAL

Design: mechanical, type 01.

Material: Ceramic stationary part, carbon ring seal and exclusion in the rotating part. Buna-N elastomer and stainless steel spring.

SHAFT SLEEVE

Stainless steel

O-RINGS

Buna-N

MOTOR

High quality premium efficiency TEFC electric motors, designed & developed in accordance with industry standards for industrial and commercial pumping applications.

- ▶ 1 & 3 phases, 60 Hz
- ▶ Rated output: 2 to 125 HP
- ▶ 1750 & 3500 RPM
- ▶ Frame sizes: 182 JM to 405 JM


HARDWARE

Carbon steel

PAINT


Air dry enamel, water based.

*For dimensions and weights, please refer to our pump user manual.

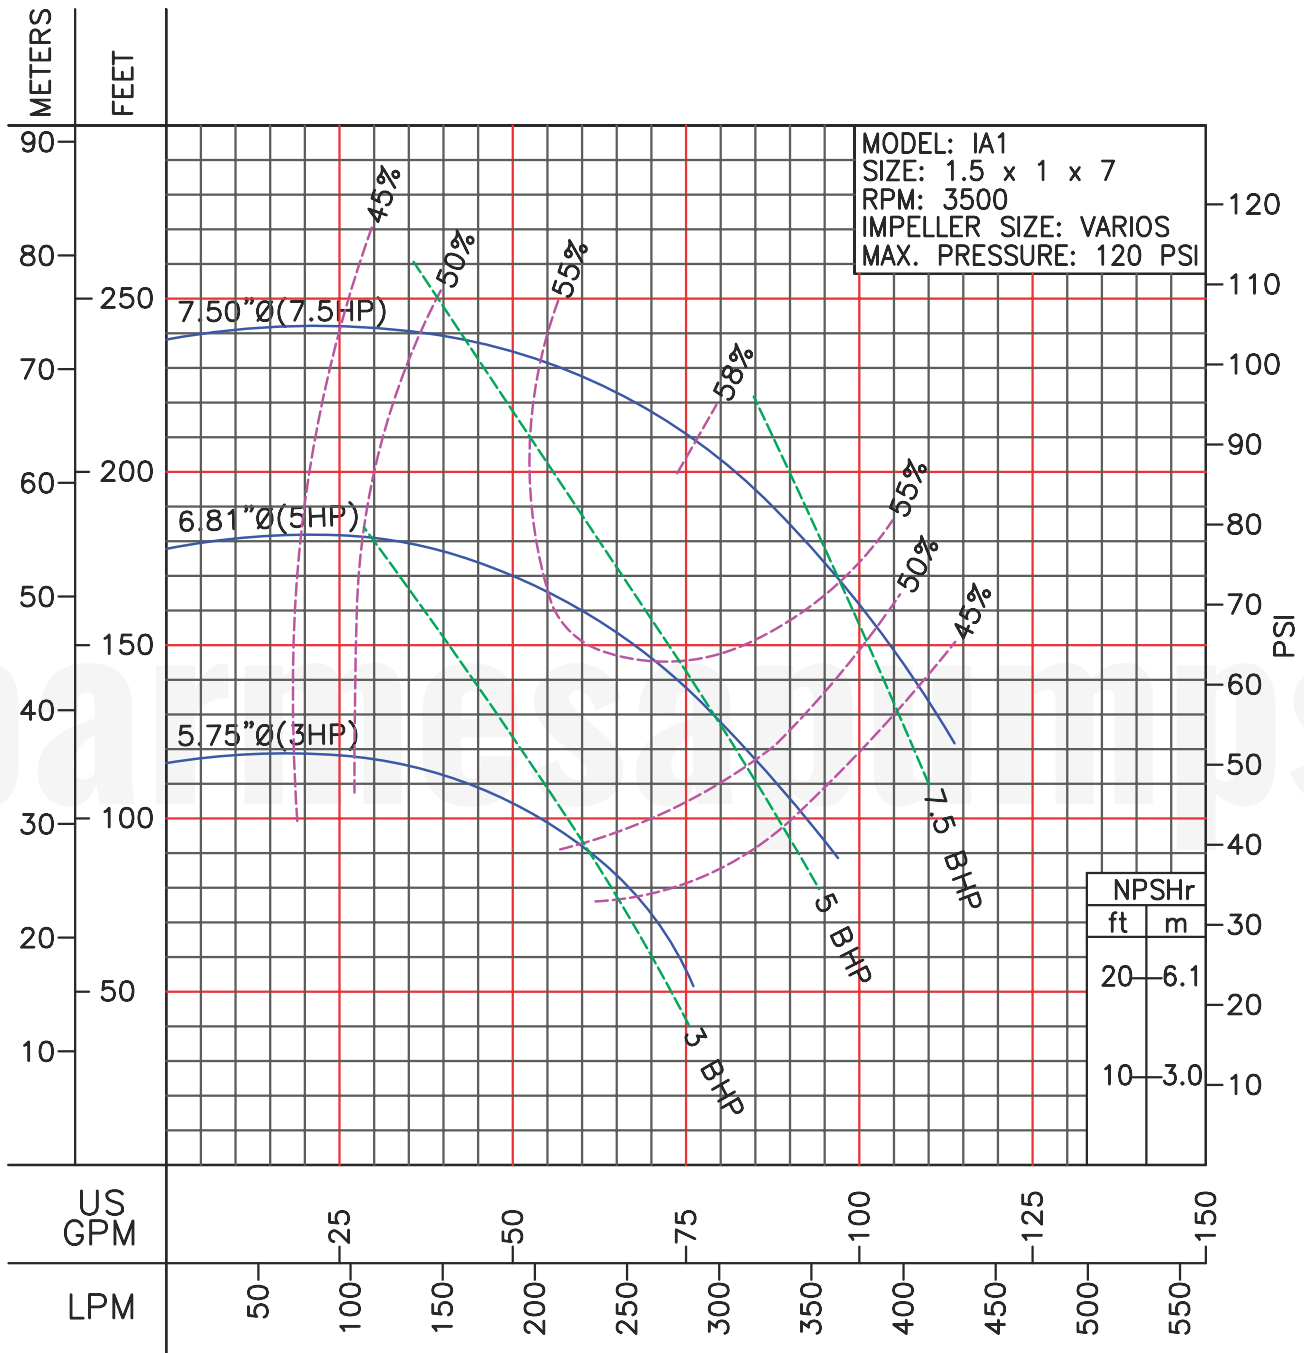

LIQUID: WATER
SPECIFIC GRAVITY : 1.00


TEMPERATURE: 70 °F (21 °C)
MAXIMUM DIAM. SOLIDS: 0.21"

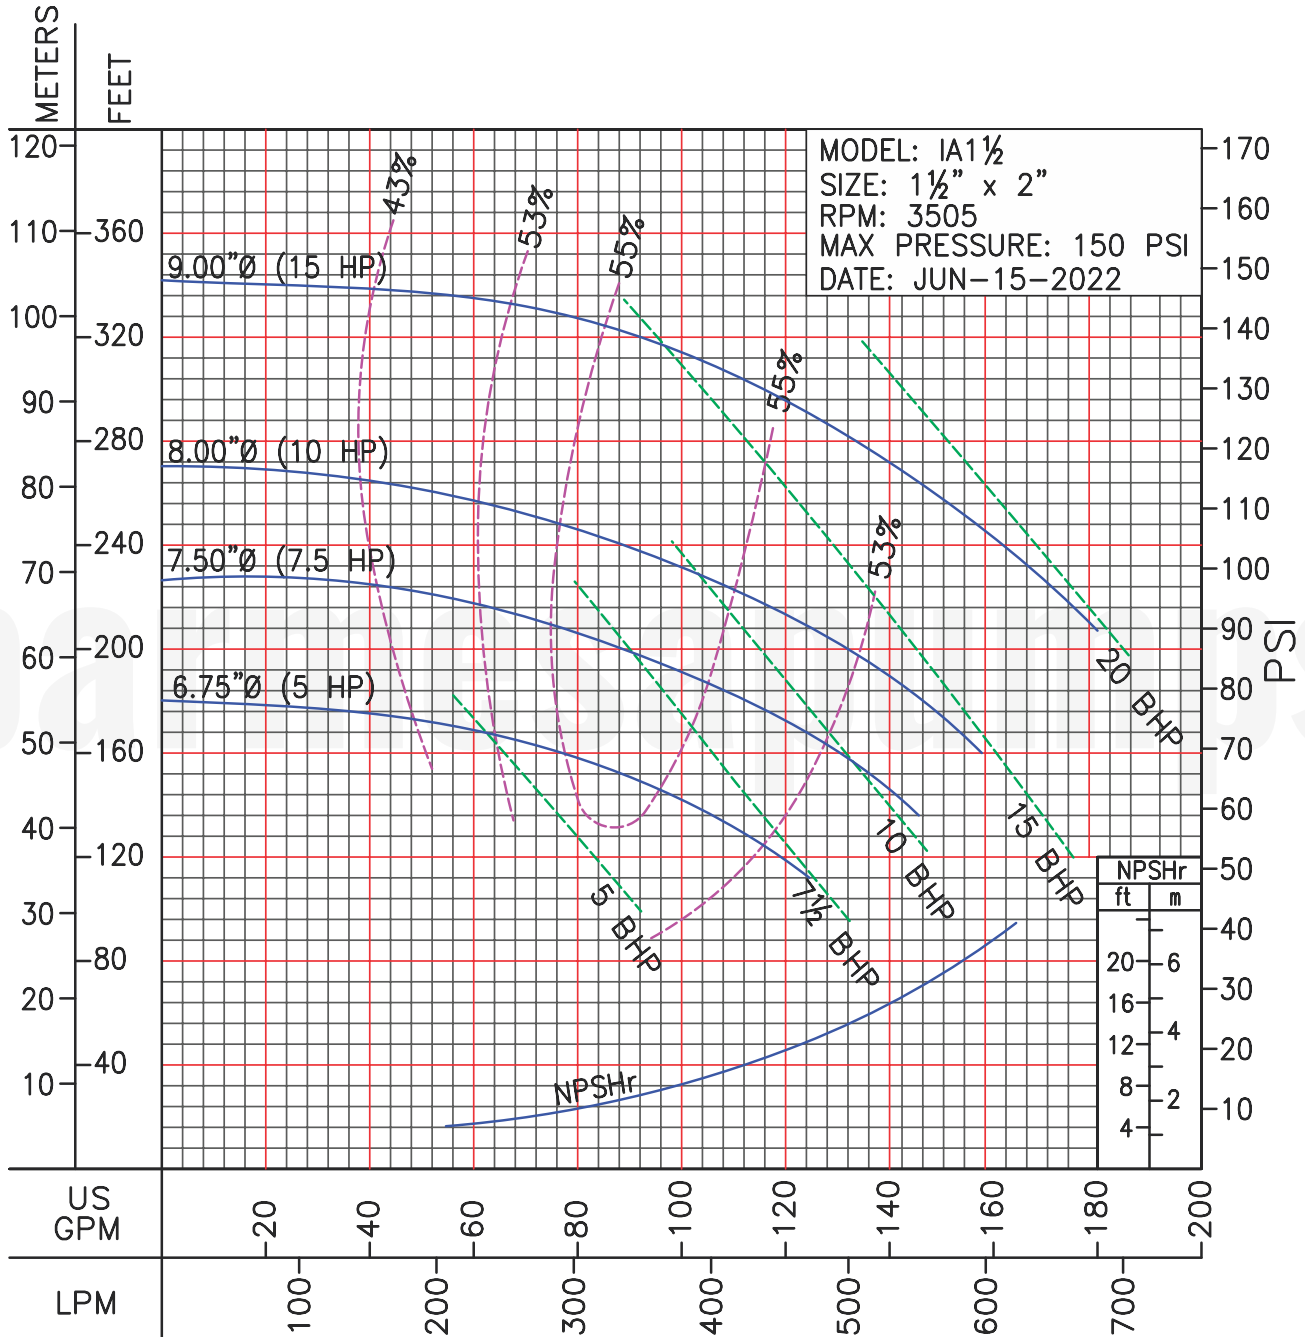

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

MODEL: **IA1½**
RPM: VARIOUS

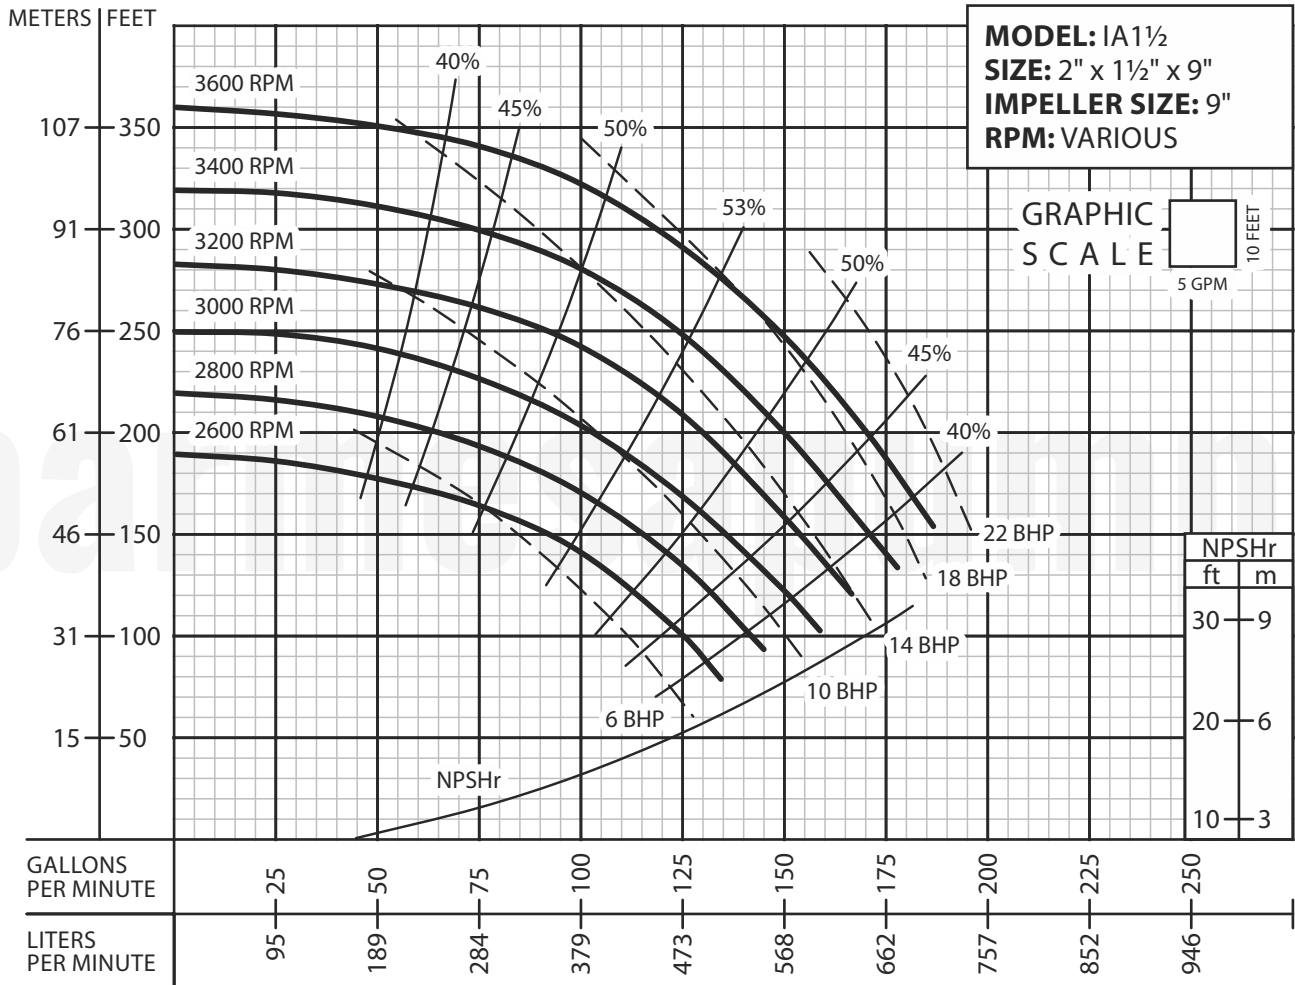


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

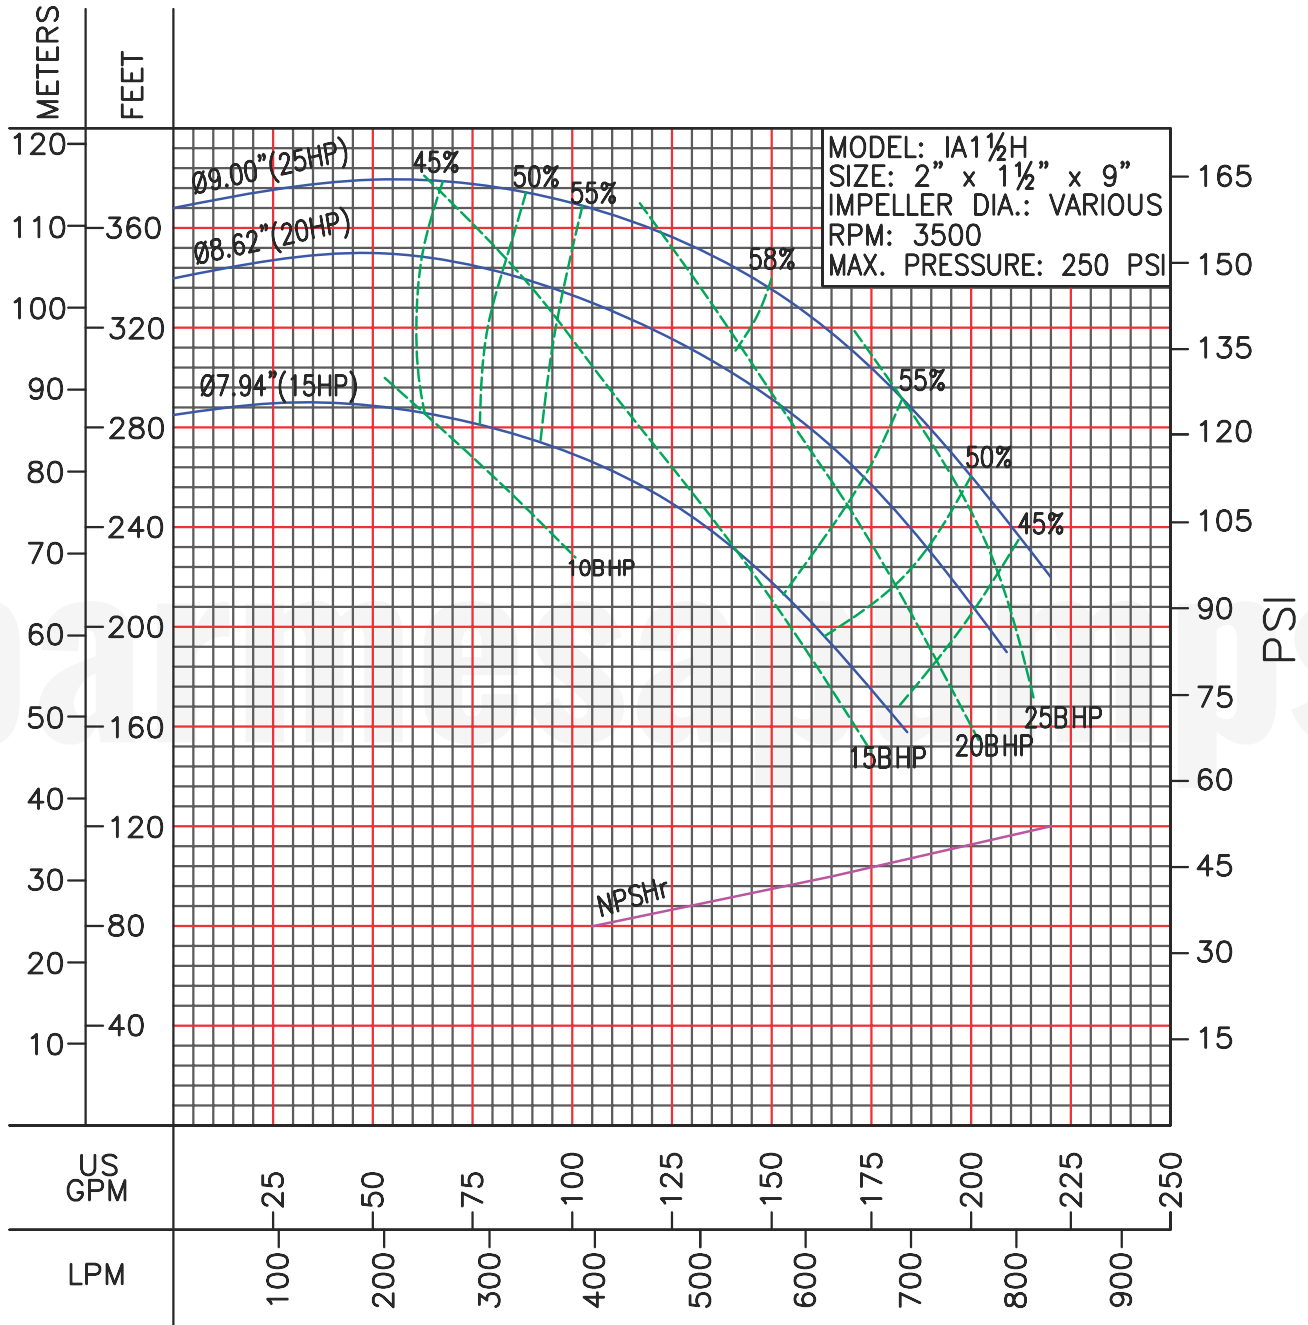


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68°F (20°C); other fluids may vary performance.

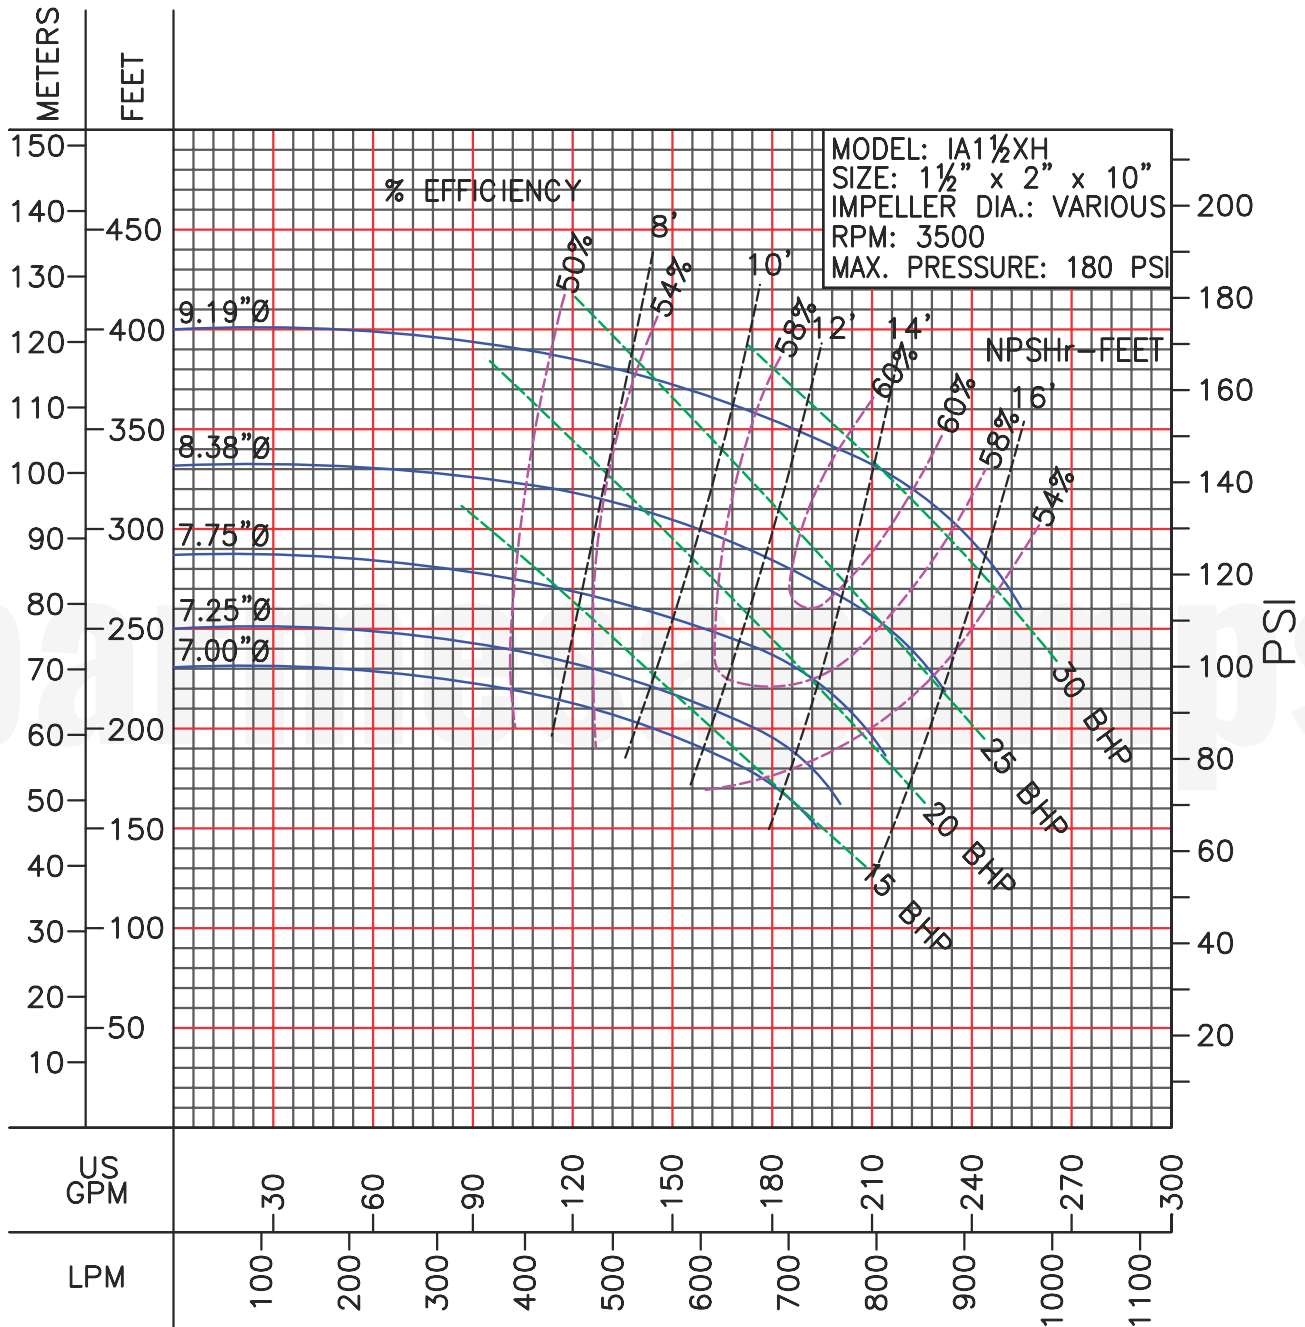

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

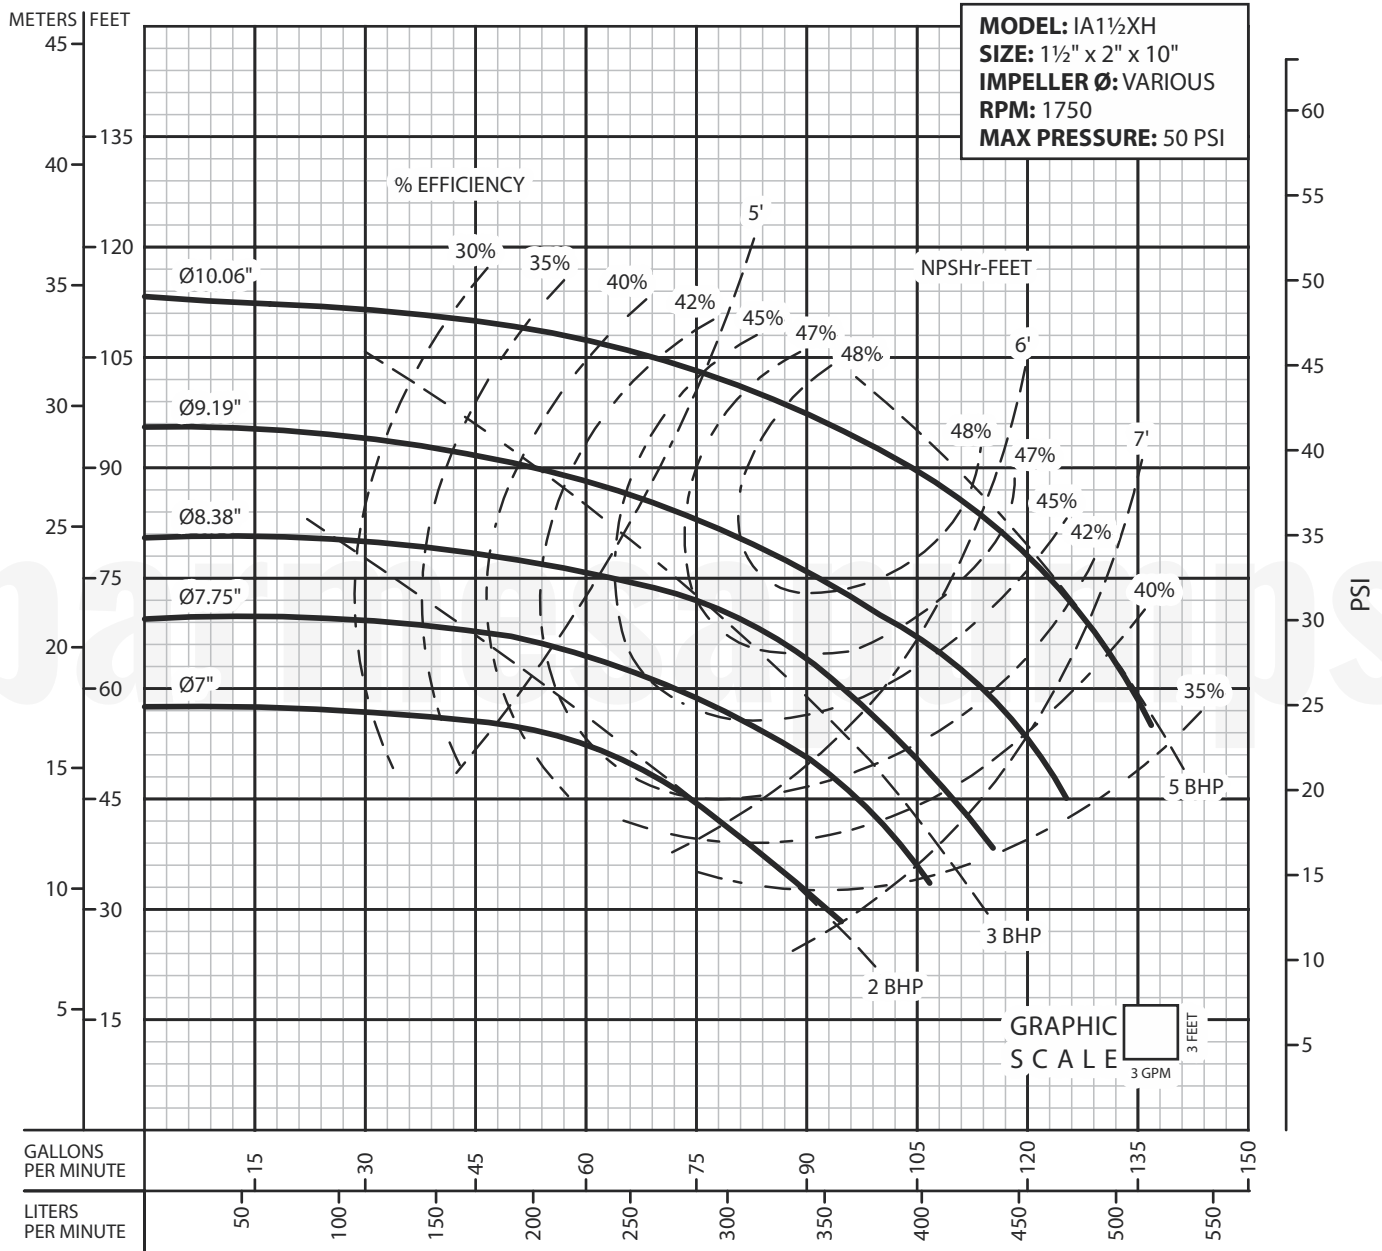

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

MODEL: **IA1½XH**
RPM: VARIOUS

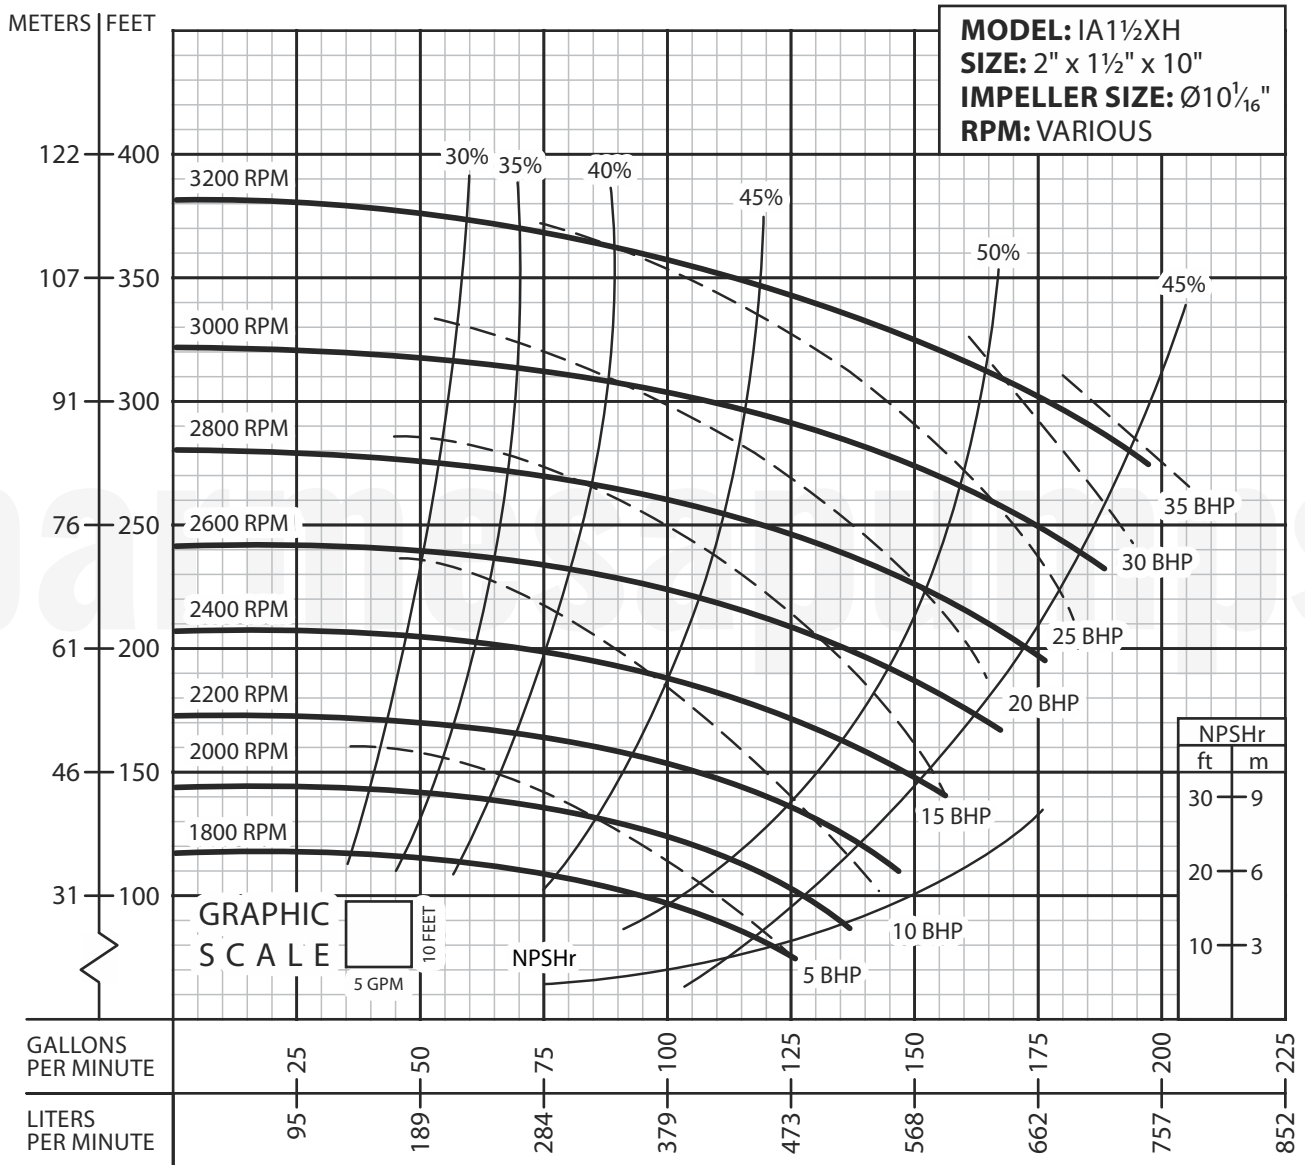


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

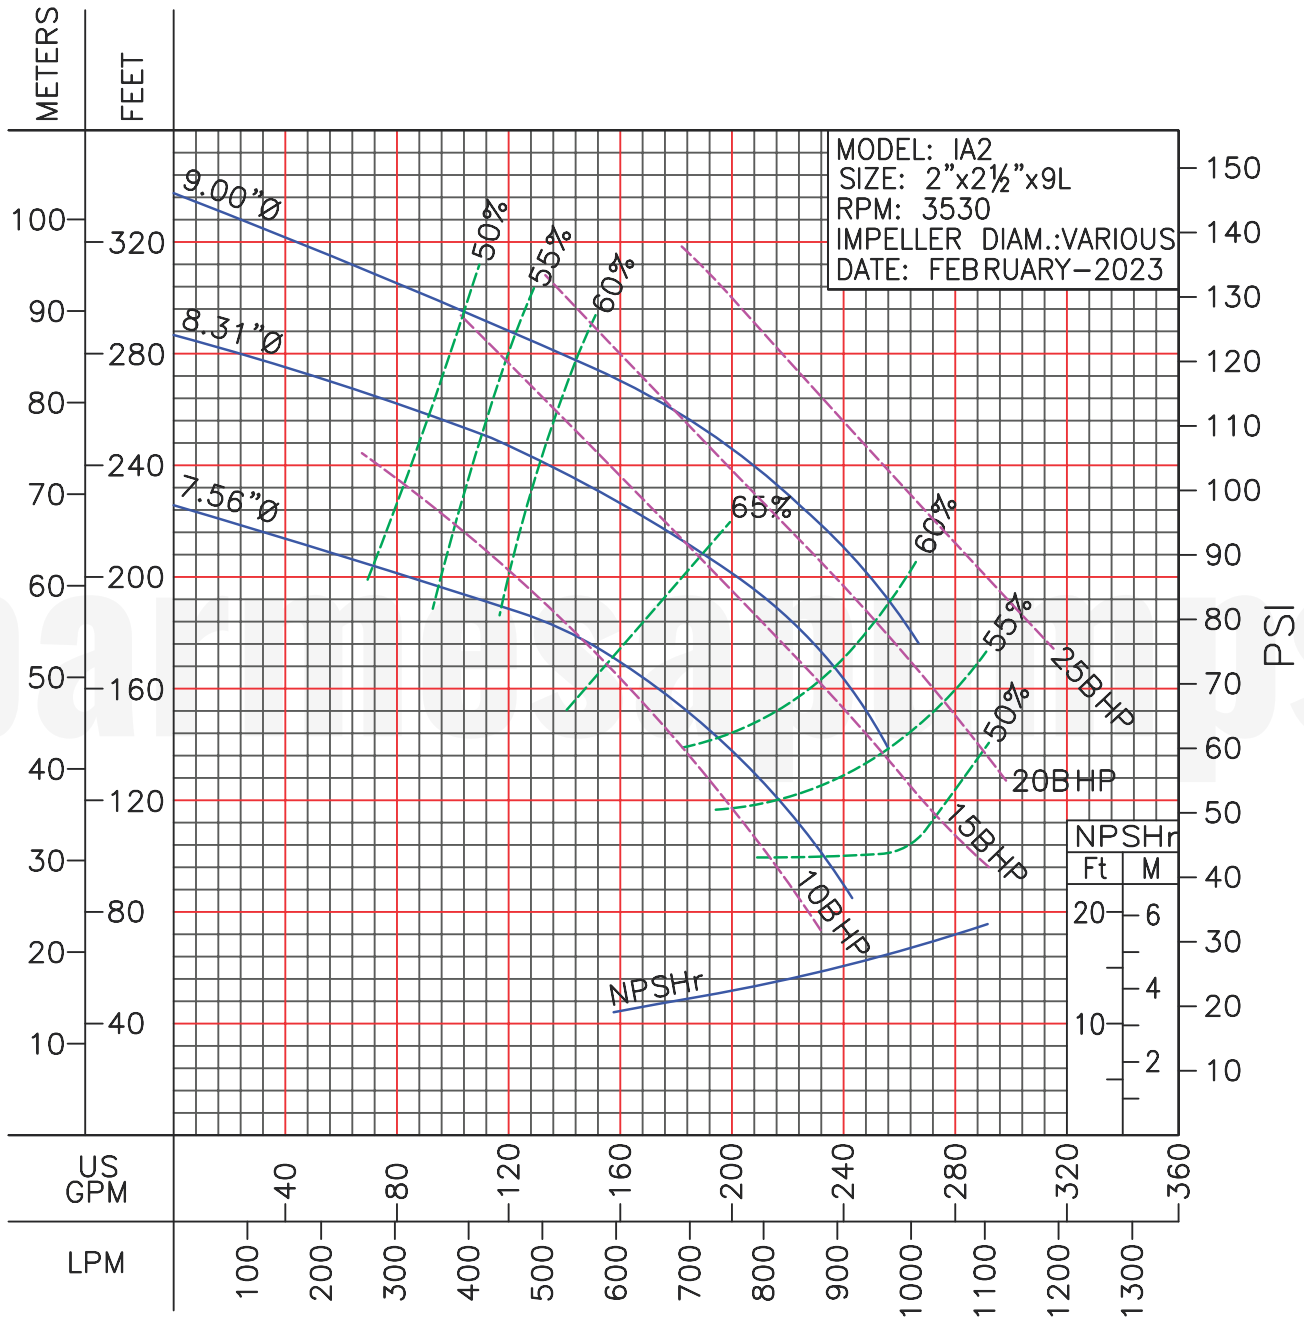

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

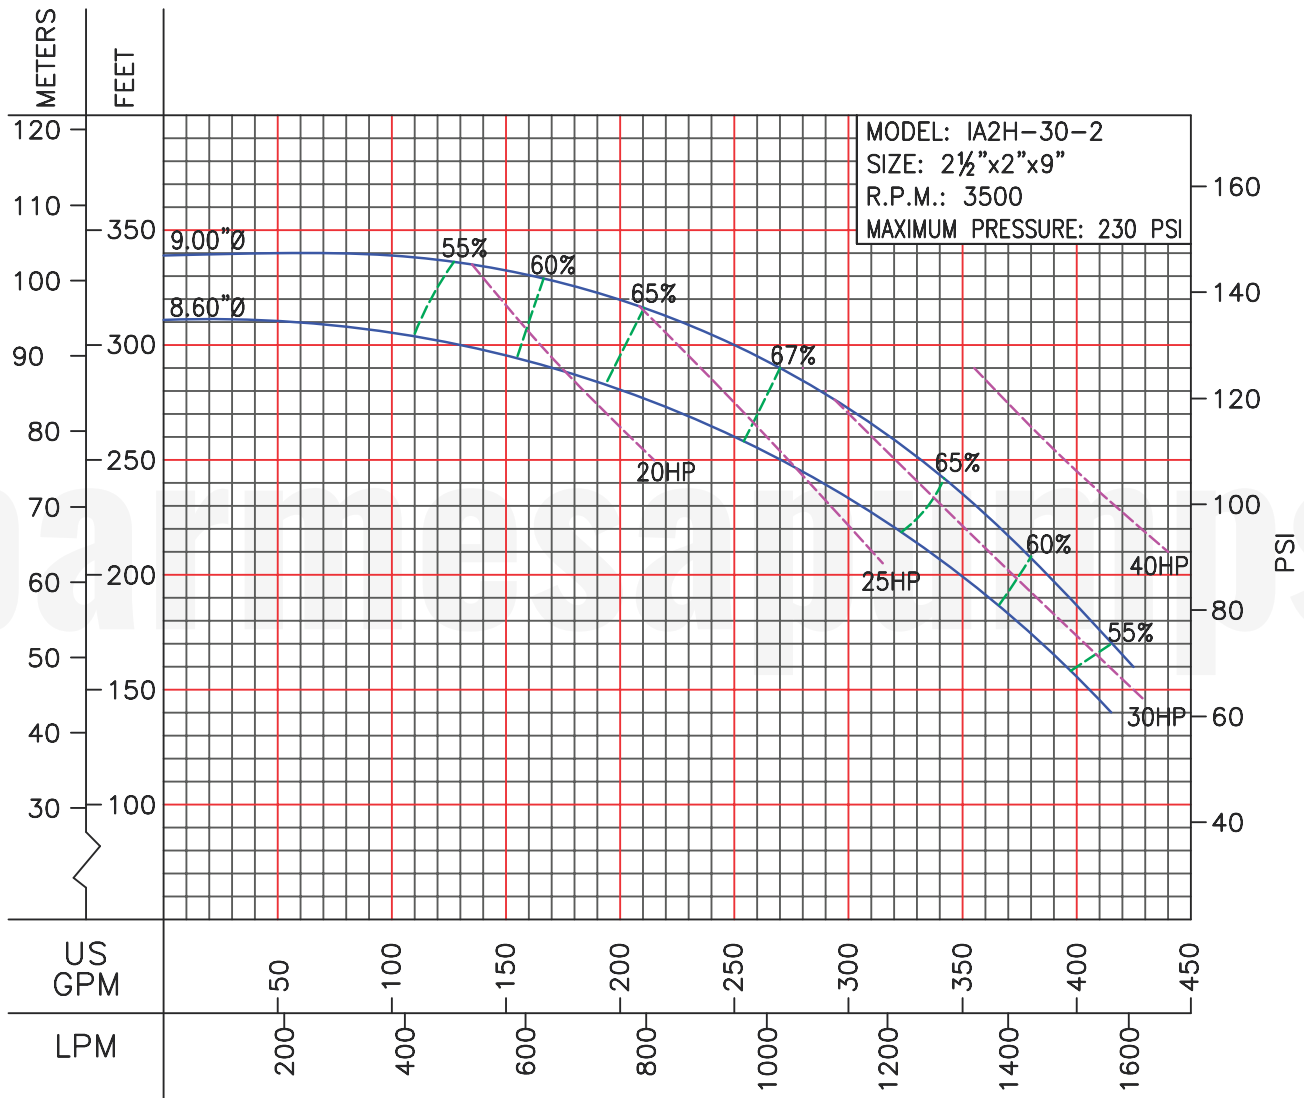

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

MODEL: **IA2H**
RPM: VARIOUS

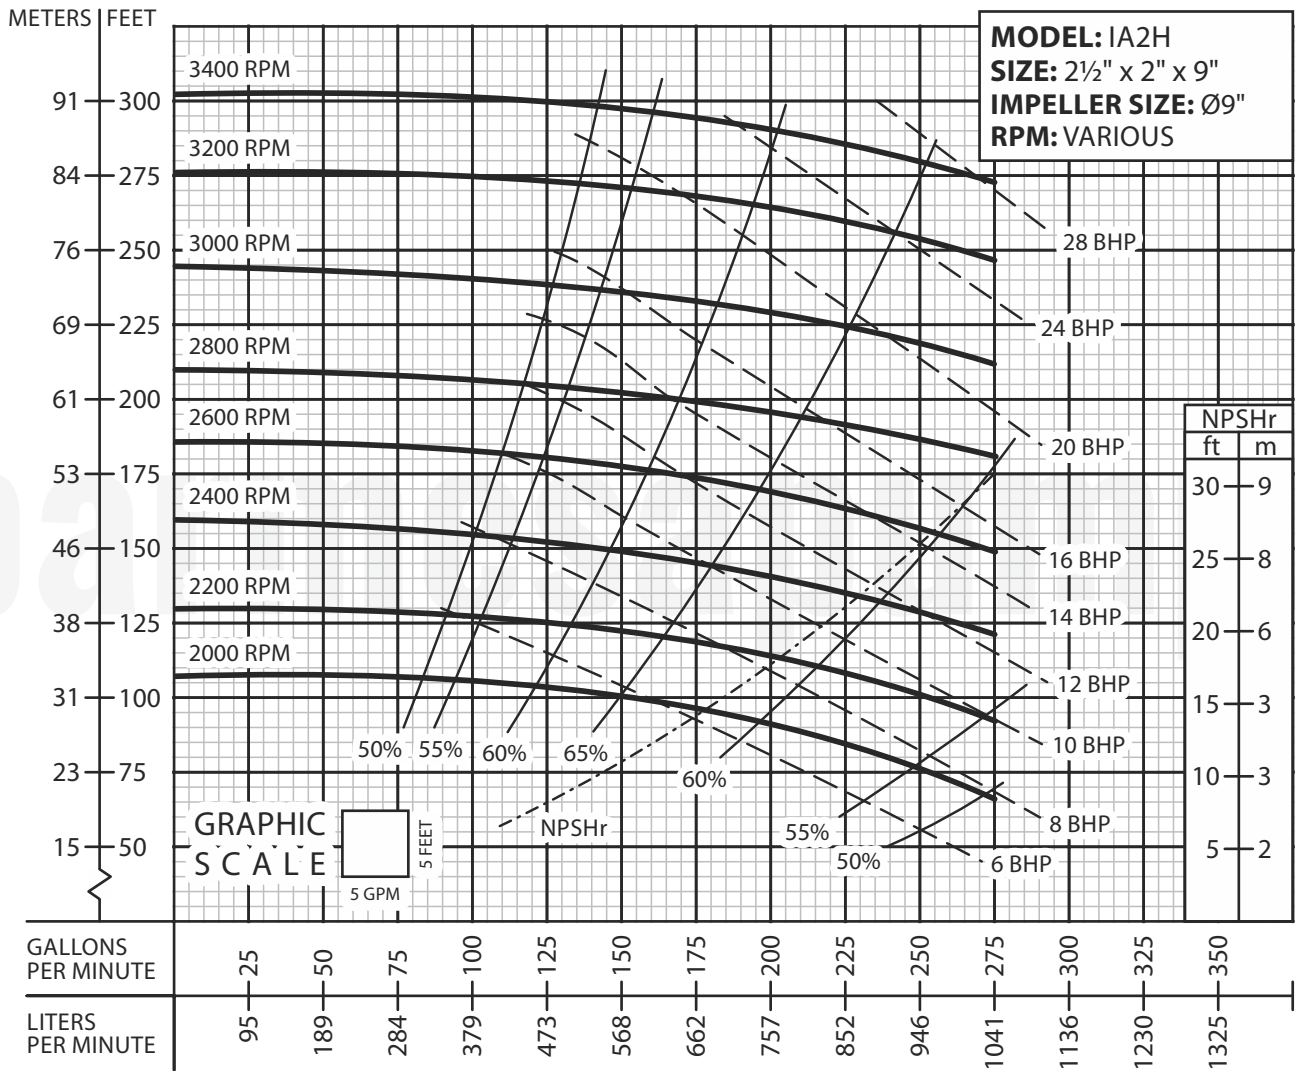


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

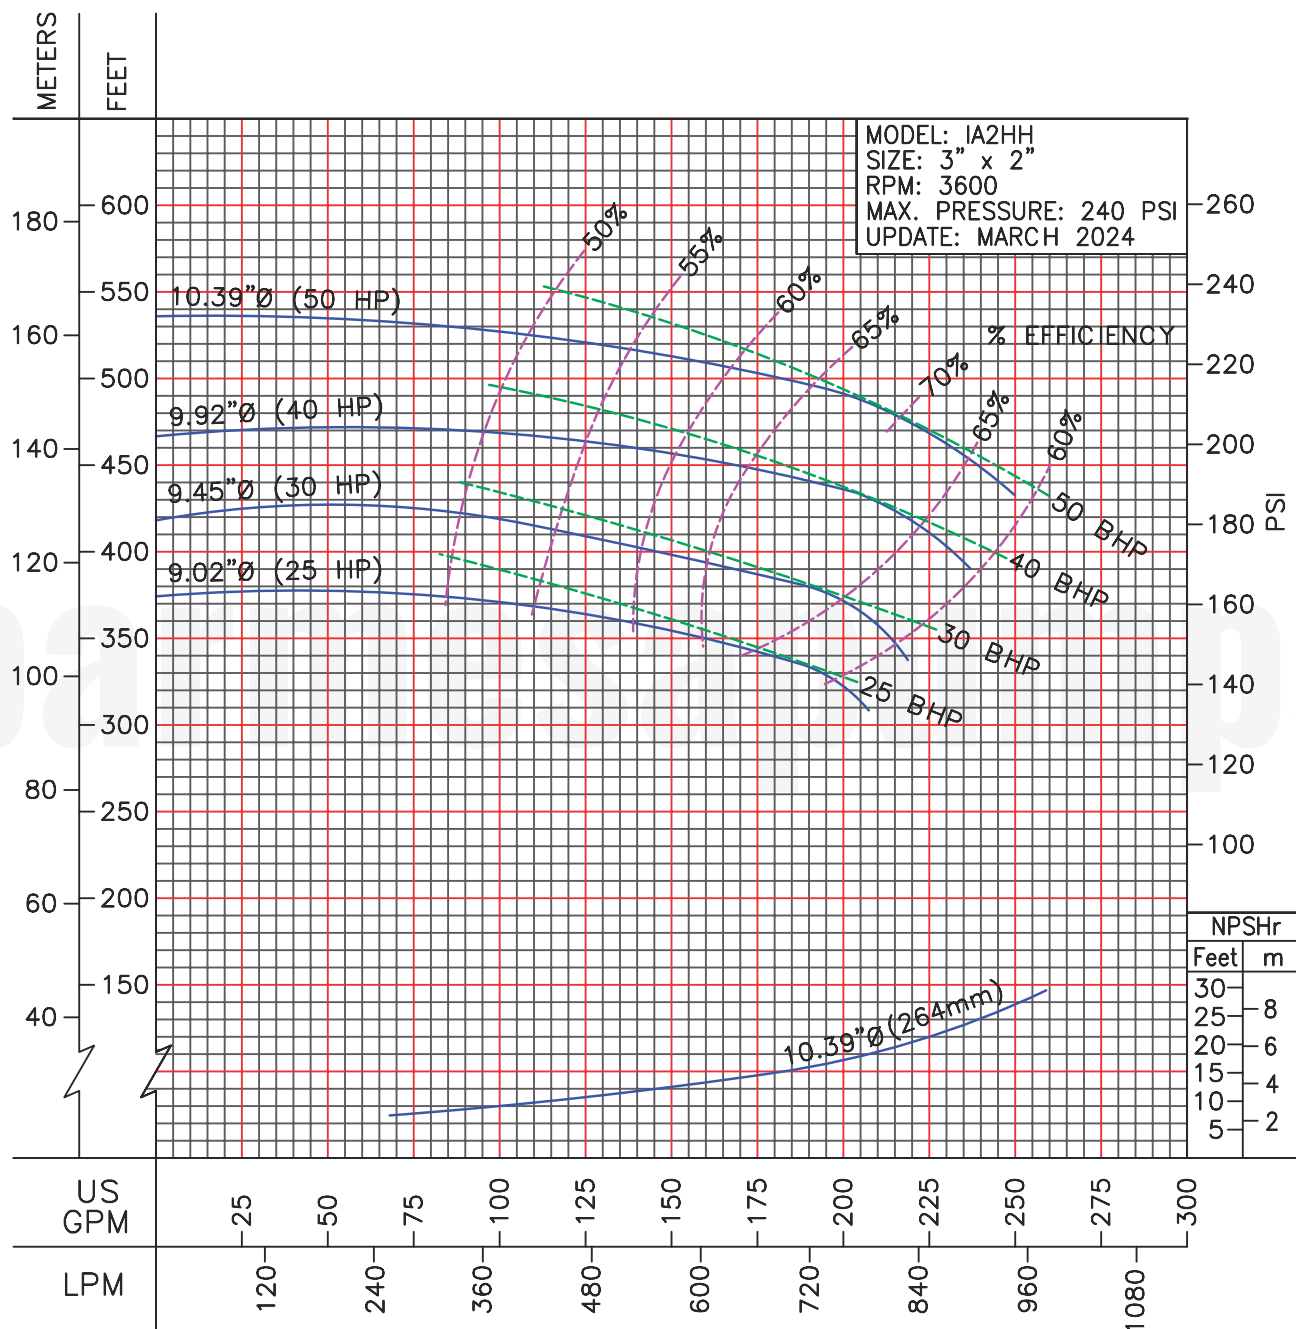

IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

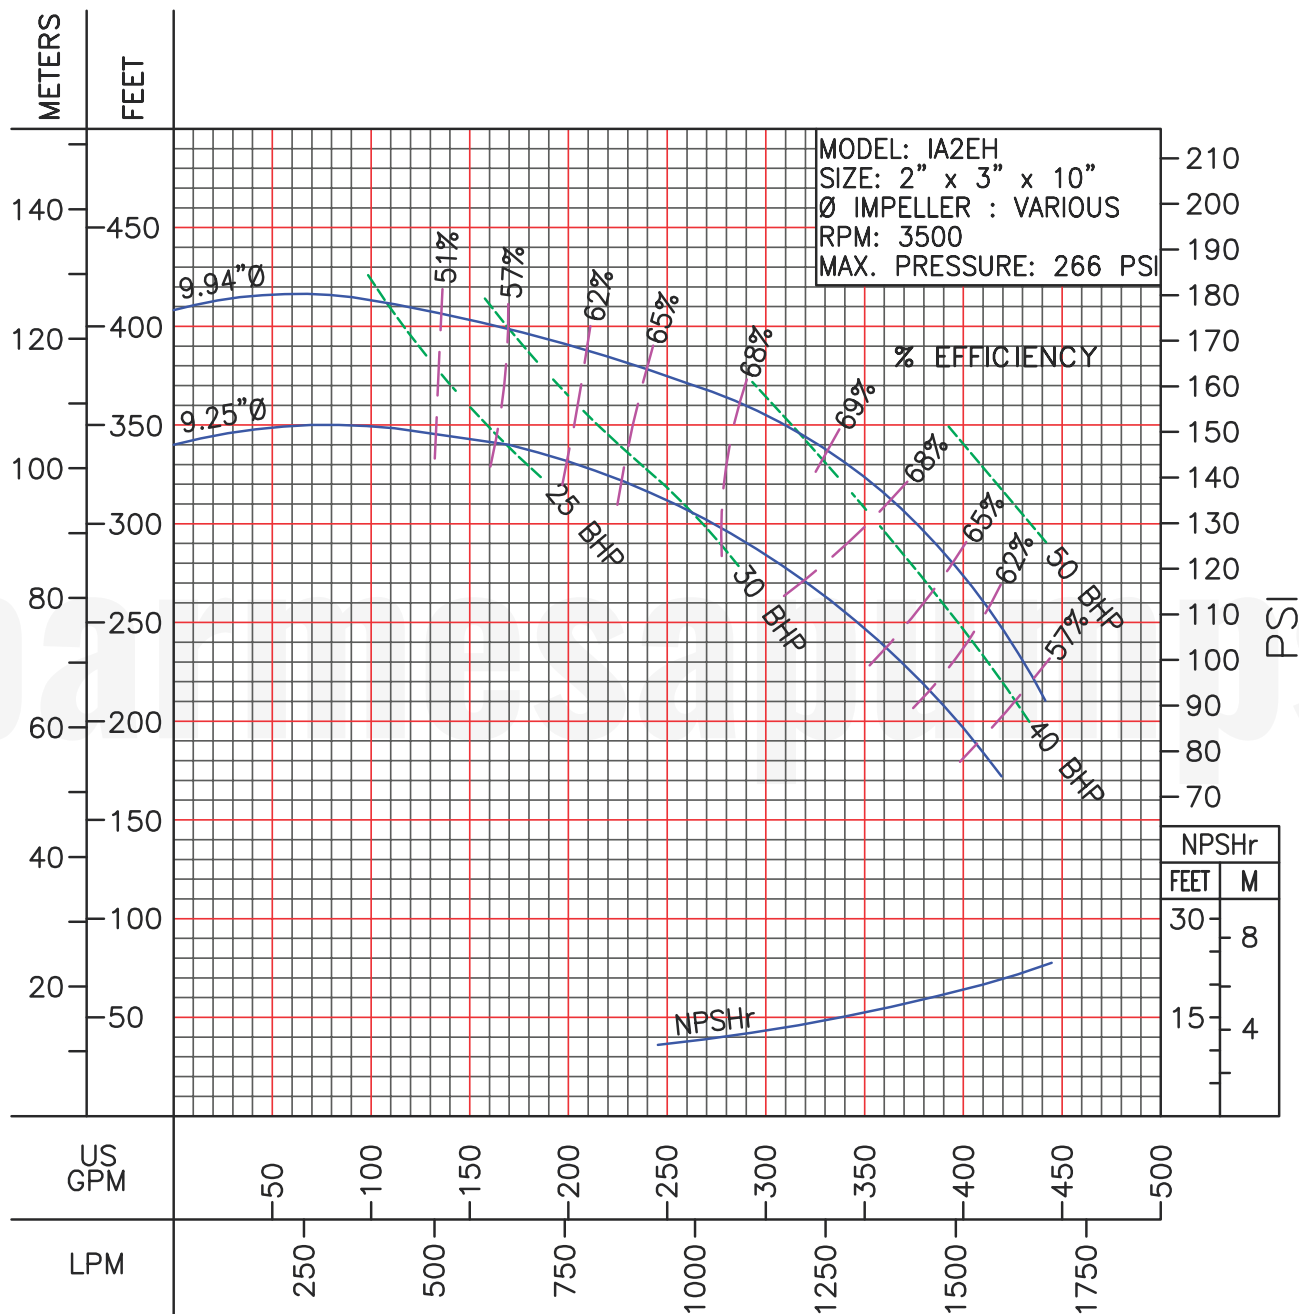


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.


MODEL: **IA2EXH**

RPM: 3500

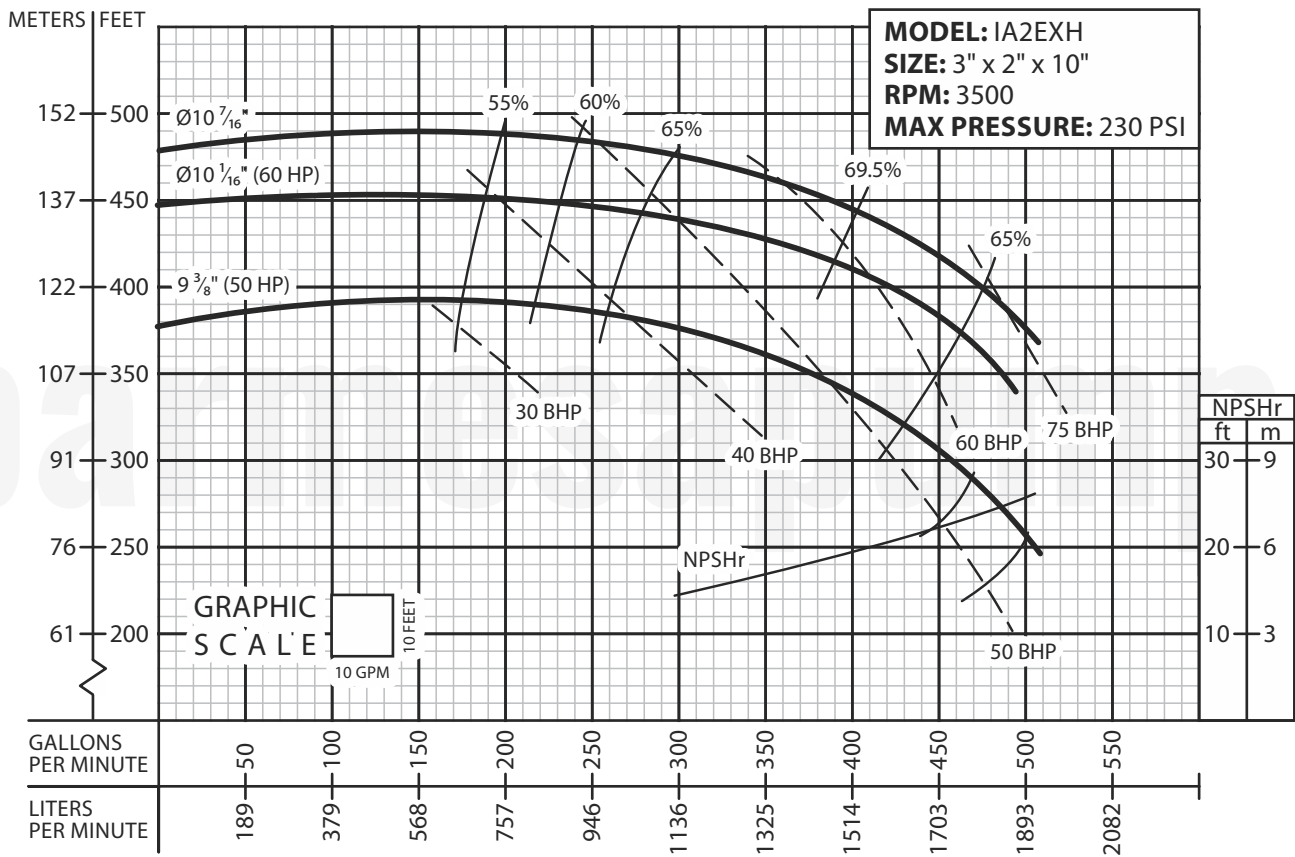

IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

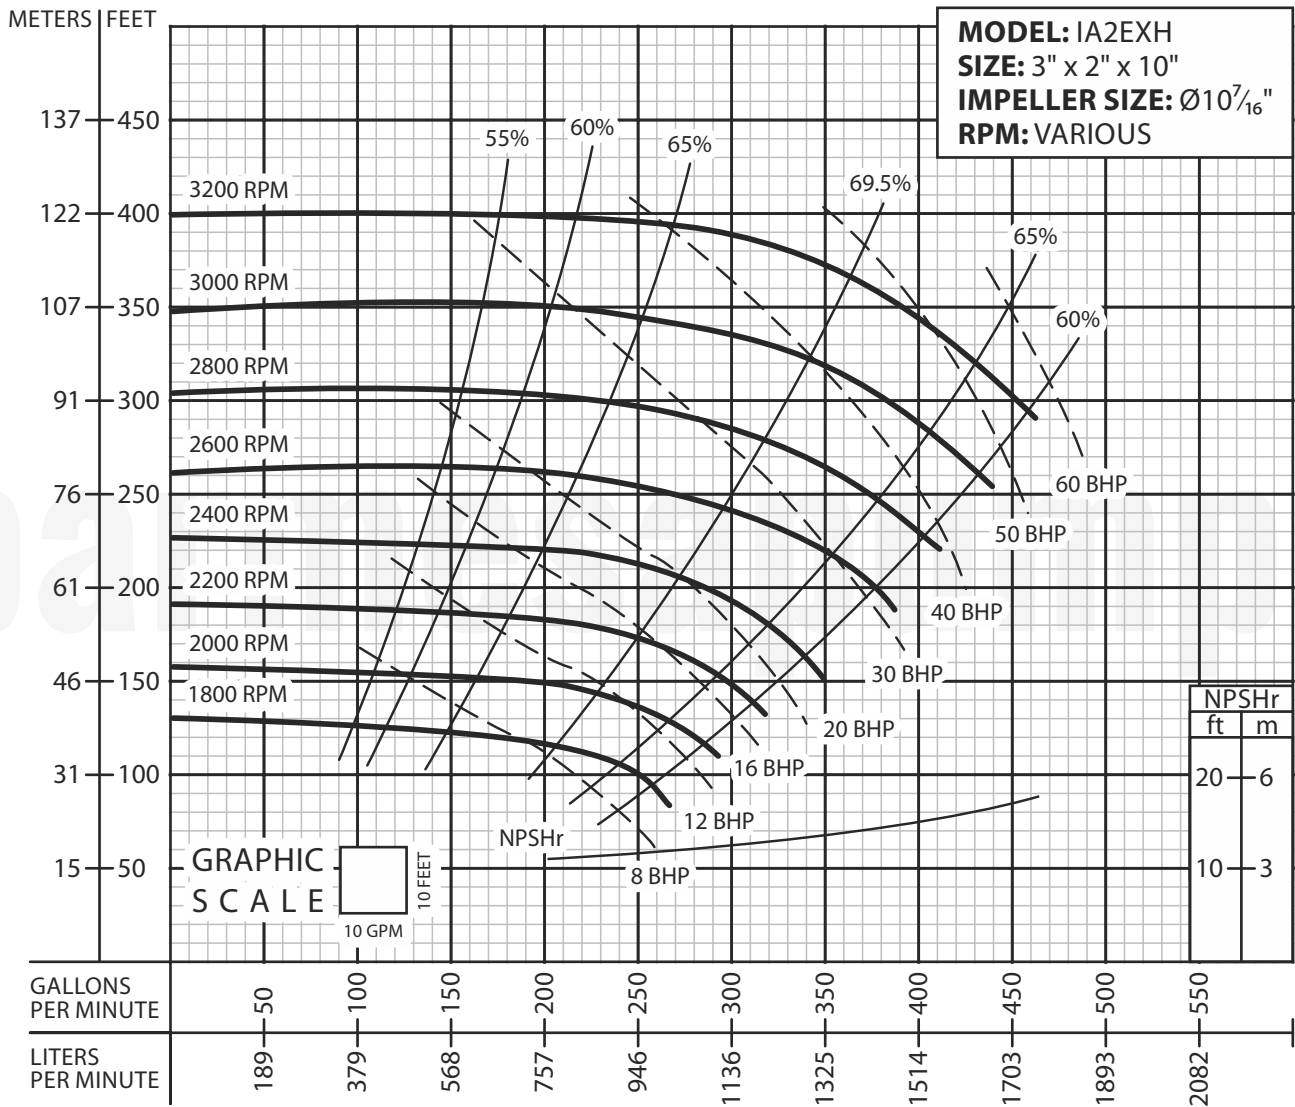


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.


MODEL: **IA2½**

RPM: 3500

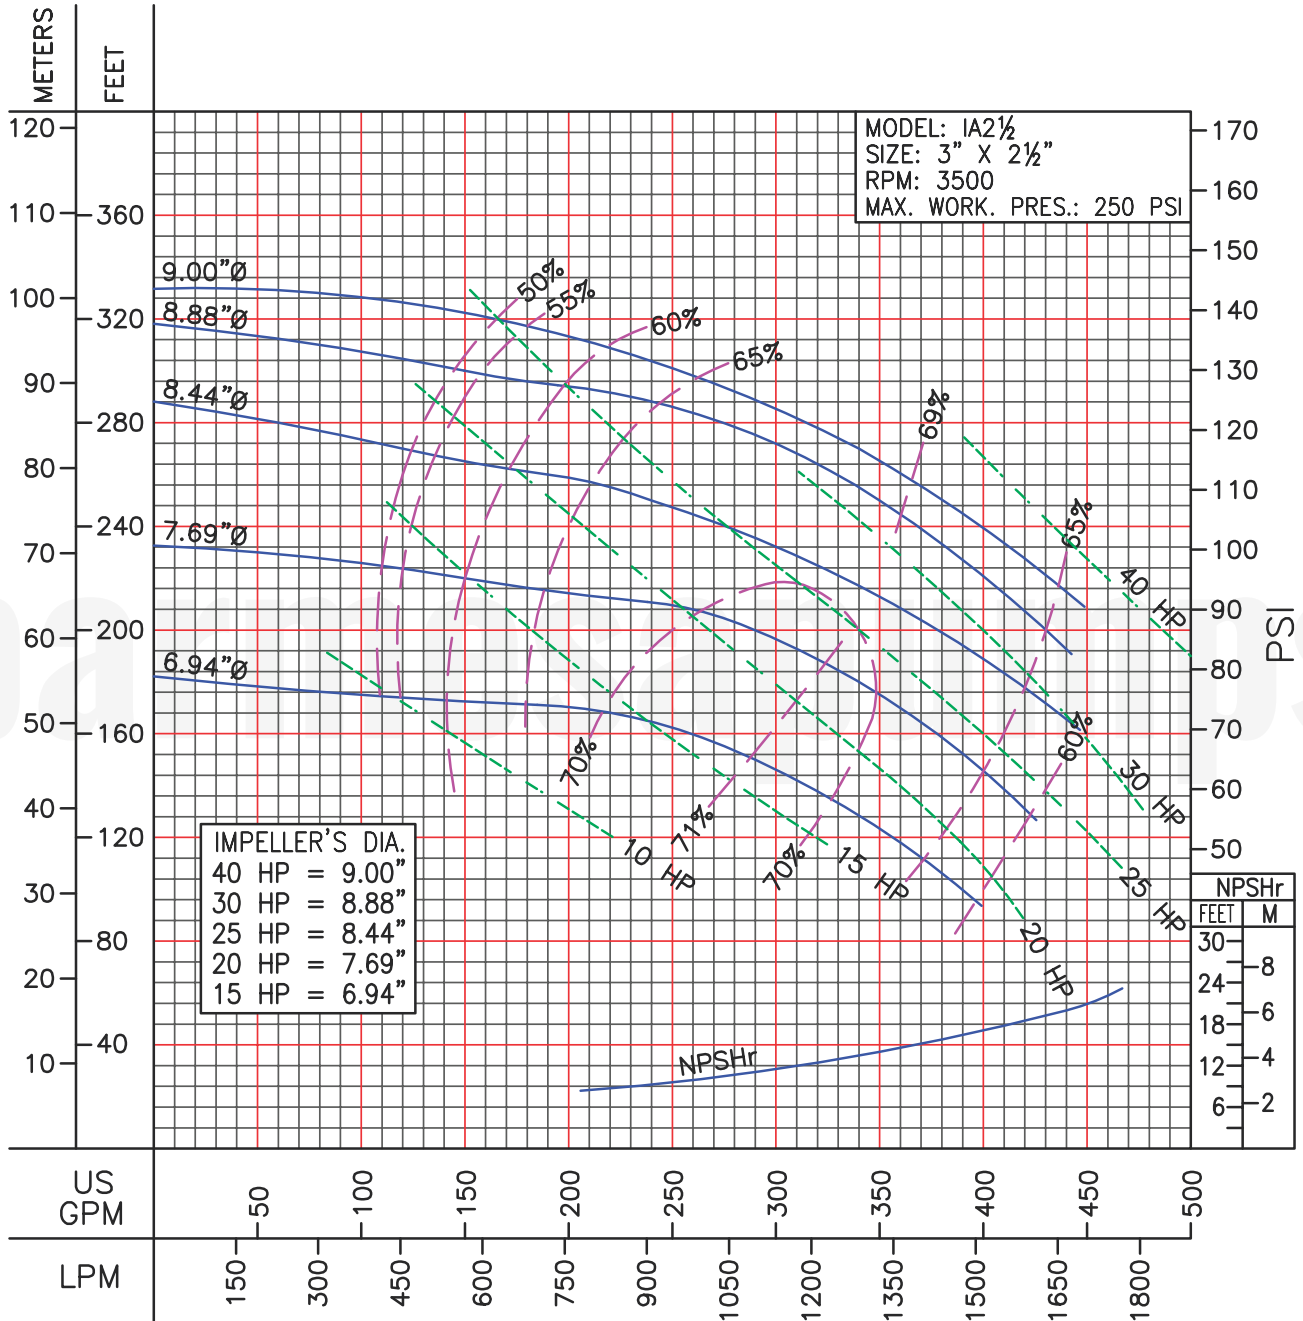

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68°F (20°C); other fluids may vary performance.

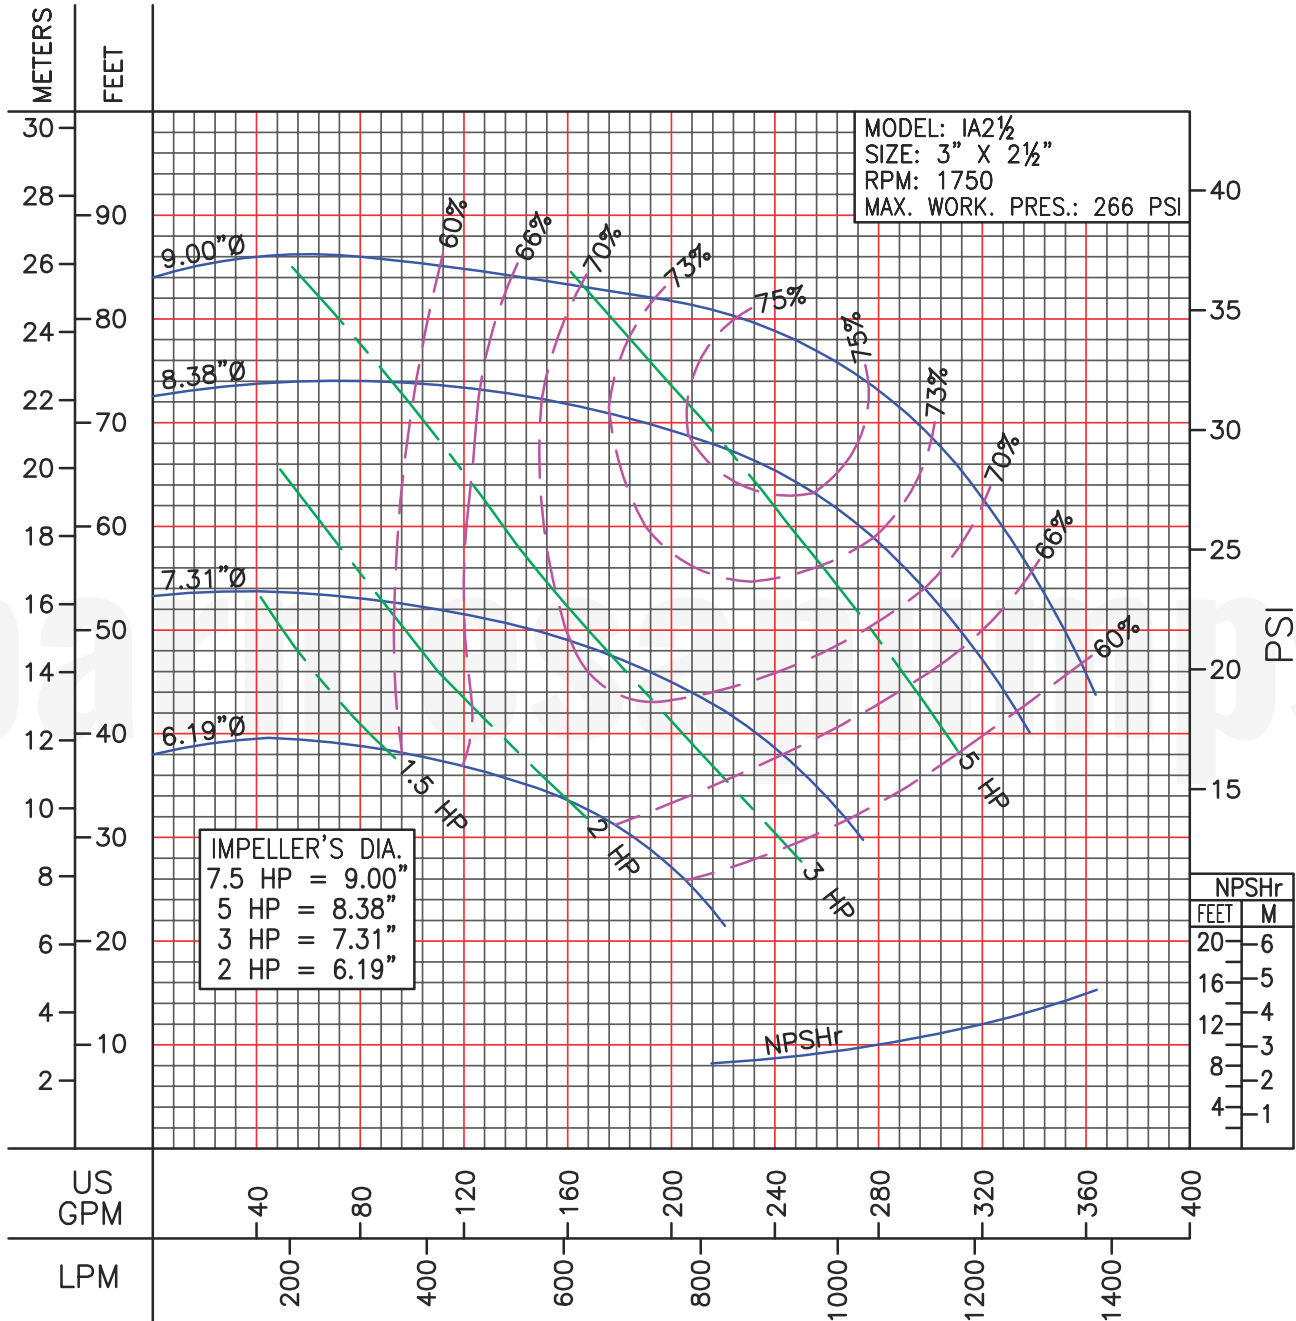

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

MODEL: **IA2½**
RPM: VARIOUS

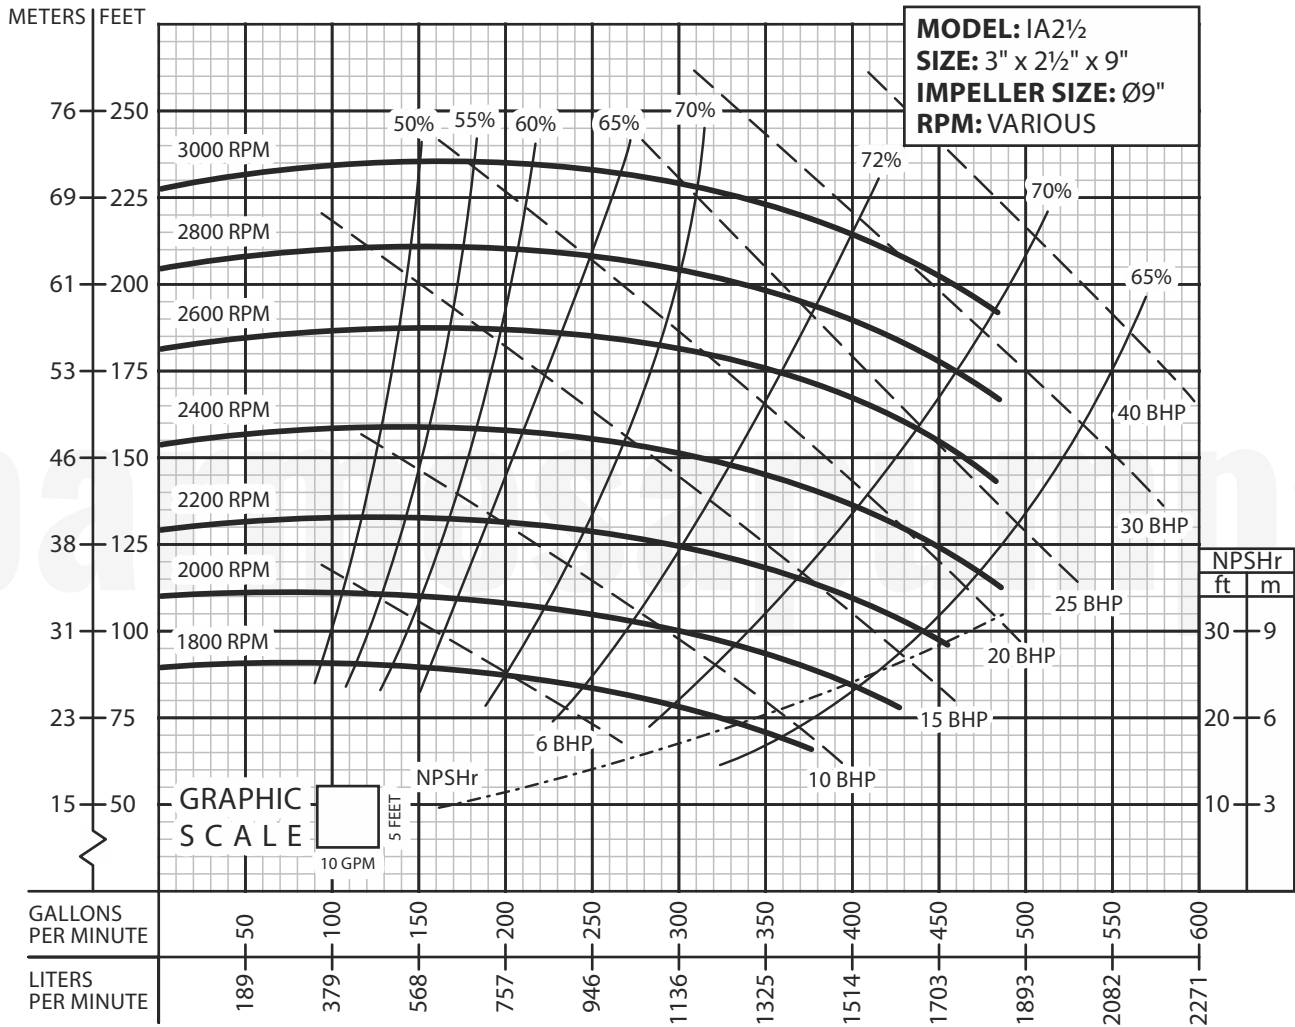


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68°F (20°C); other fluids may vary performance.

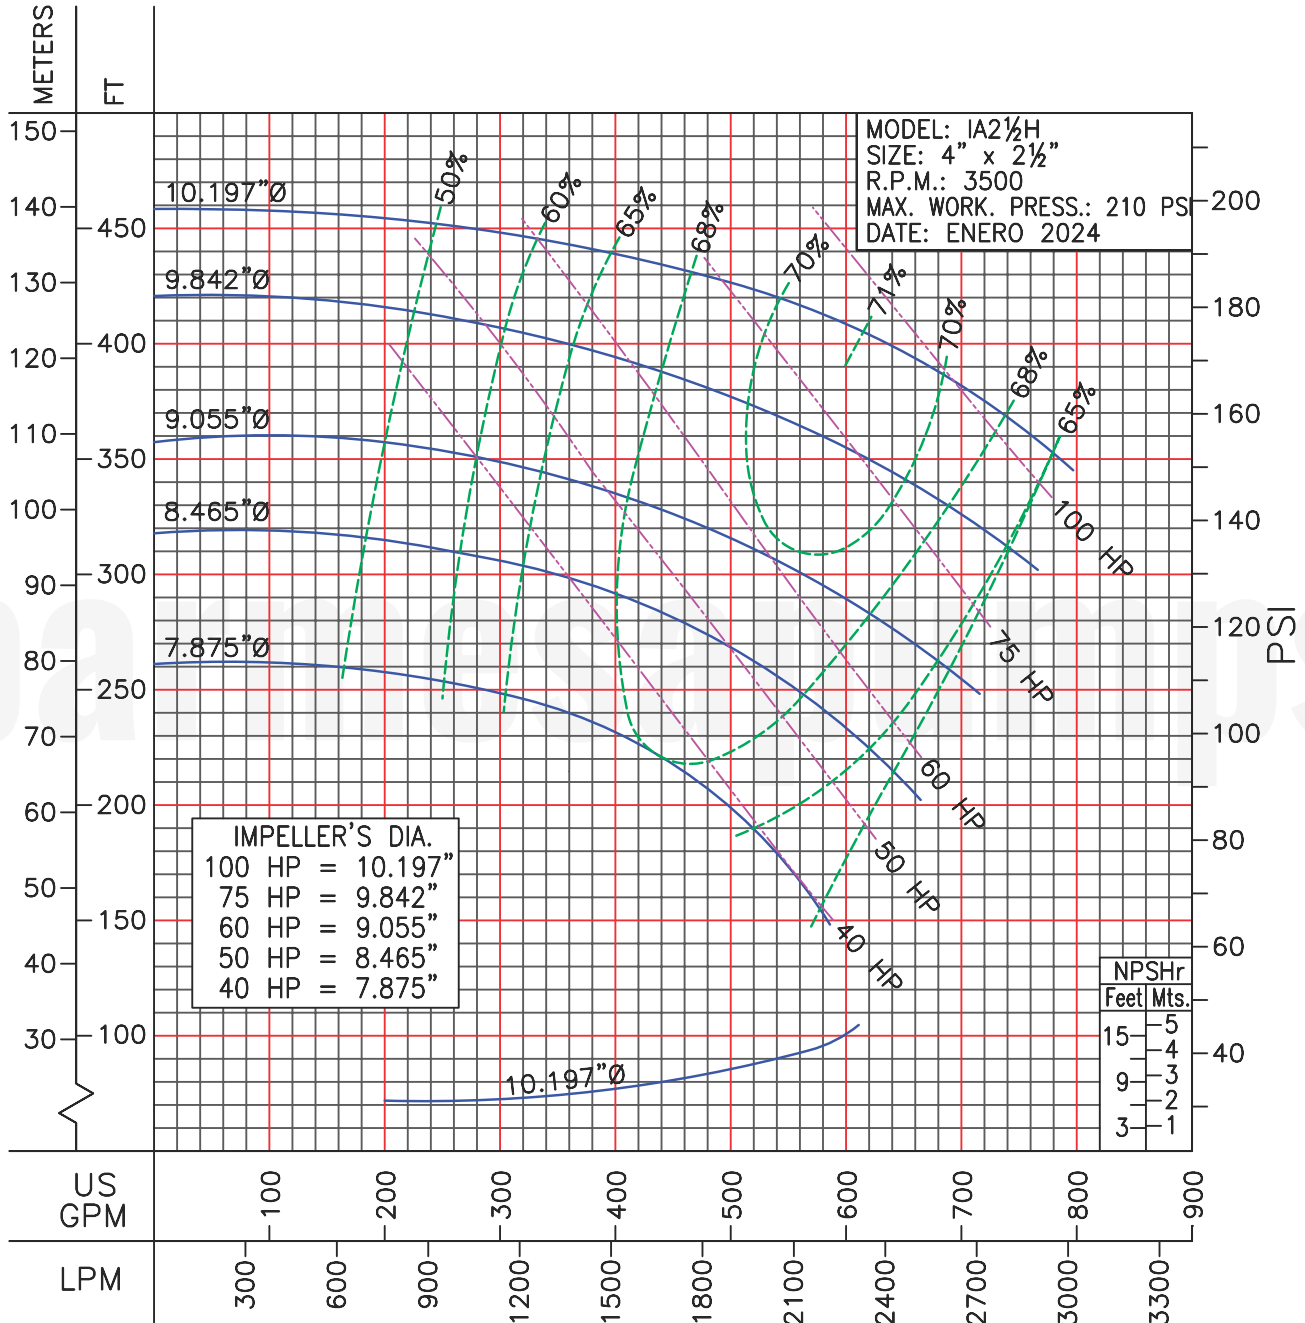


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

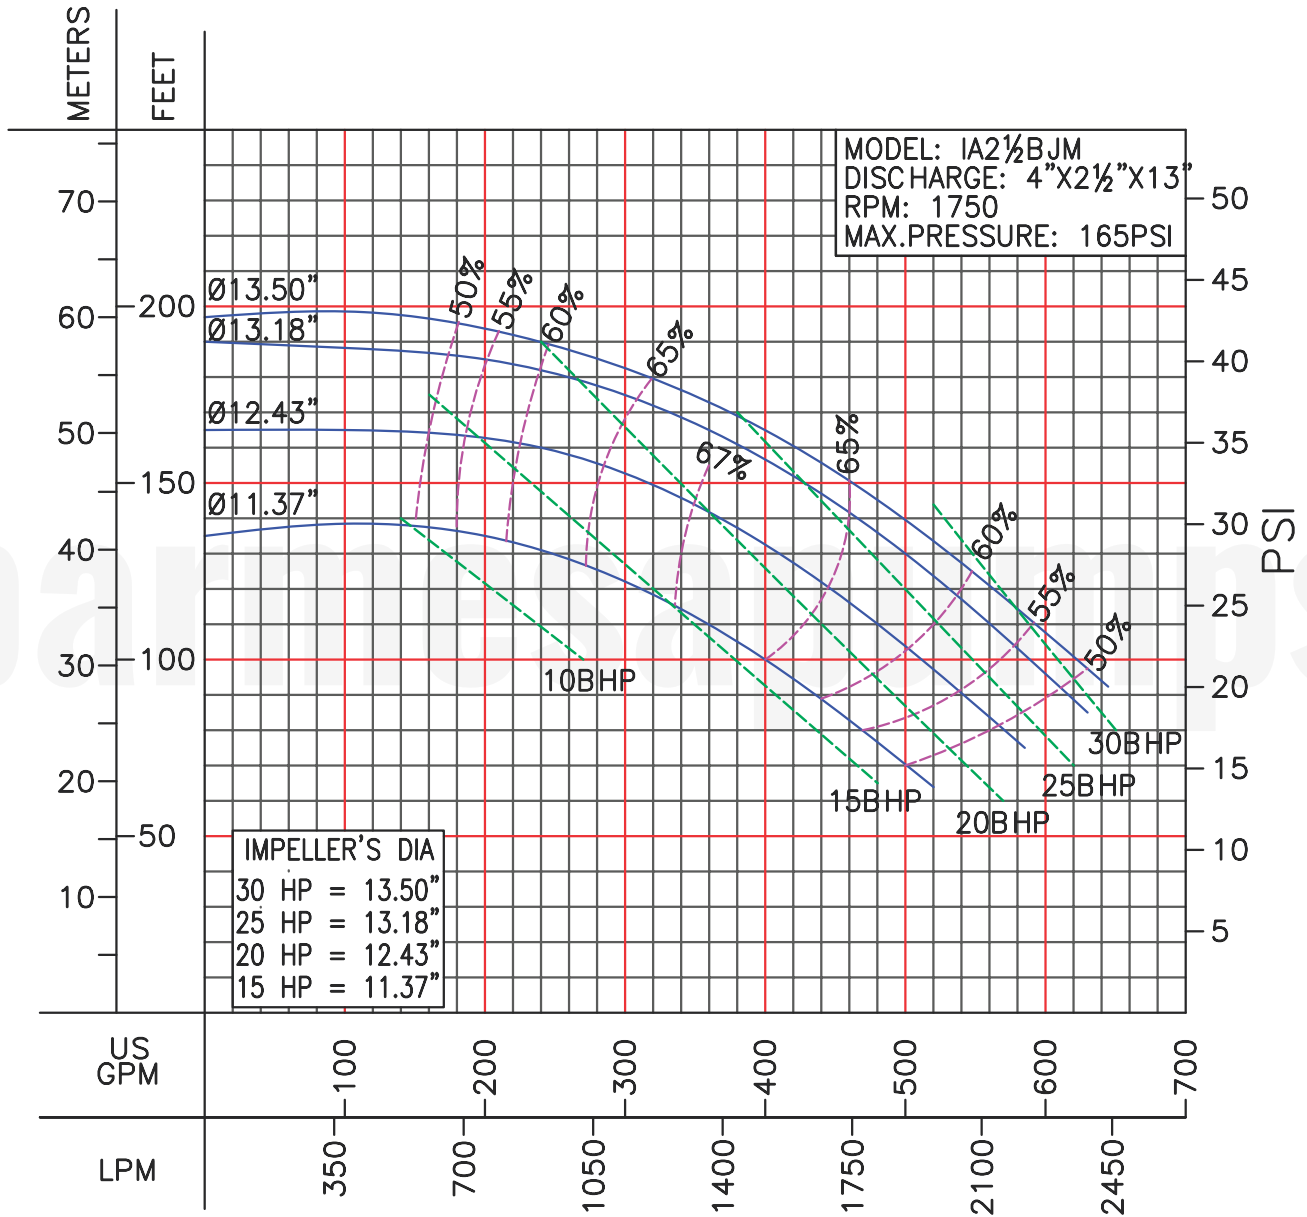


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

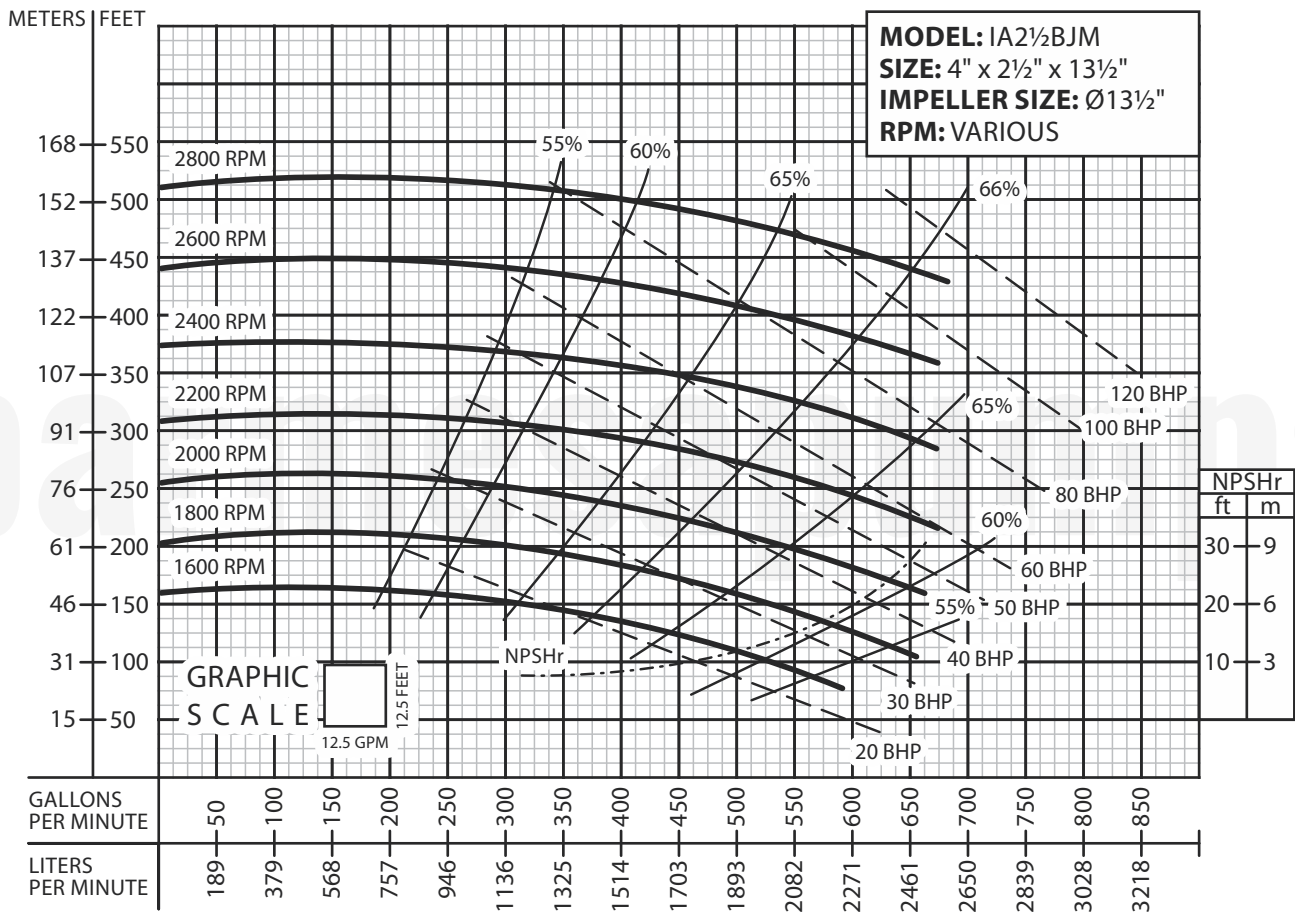


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

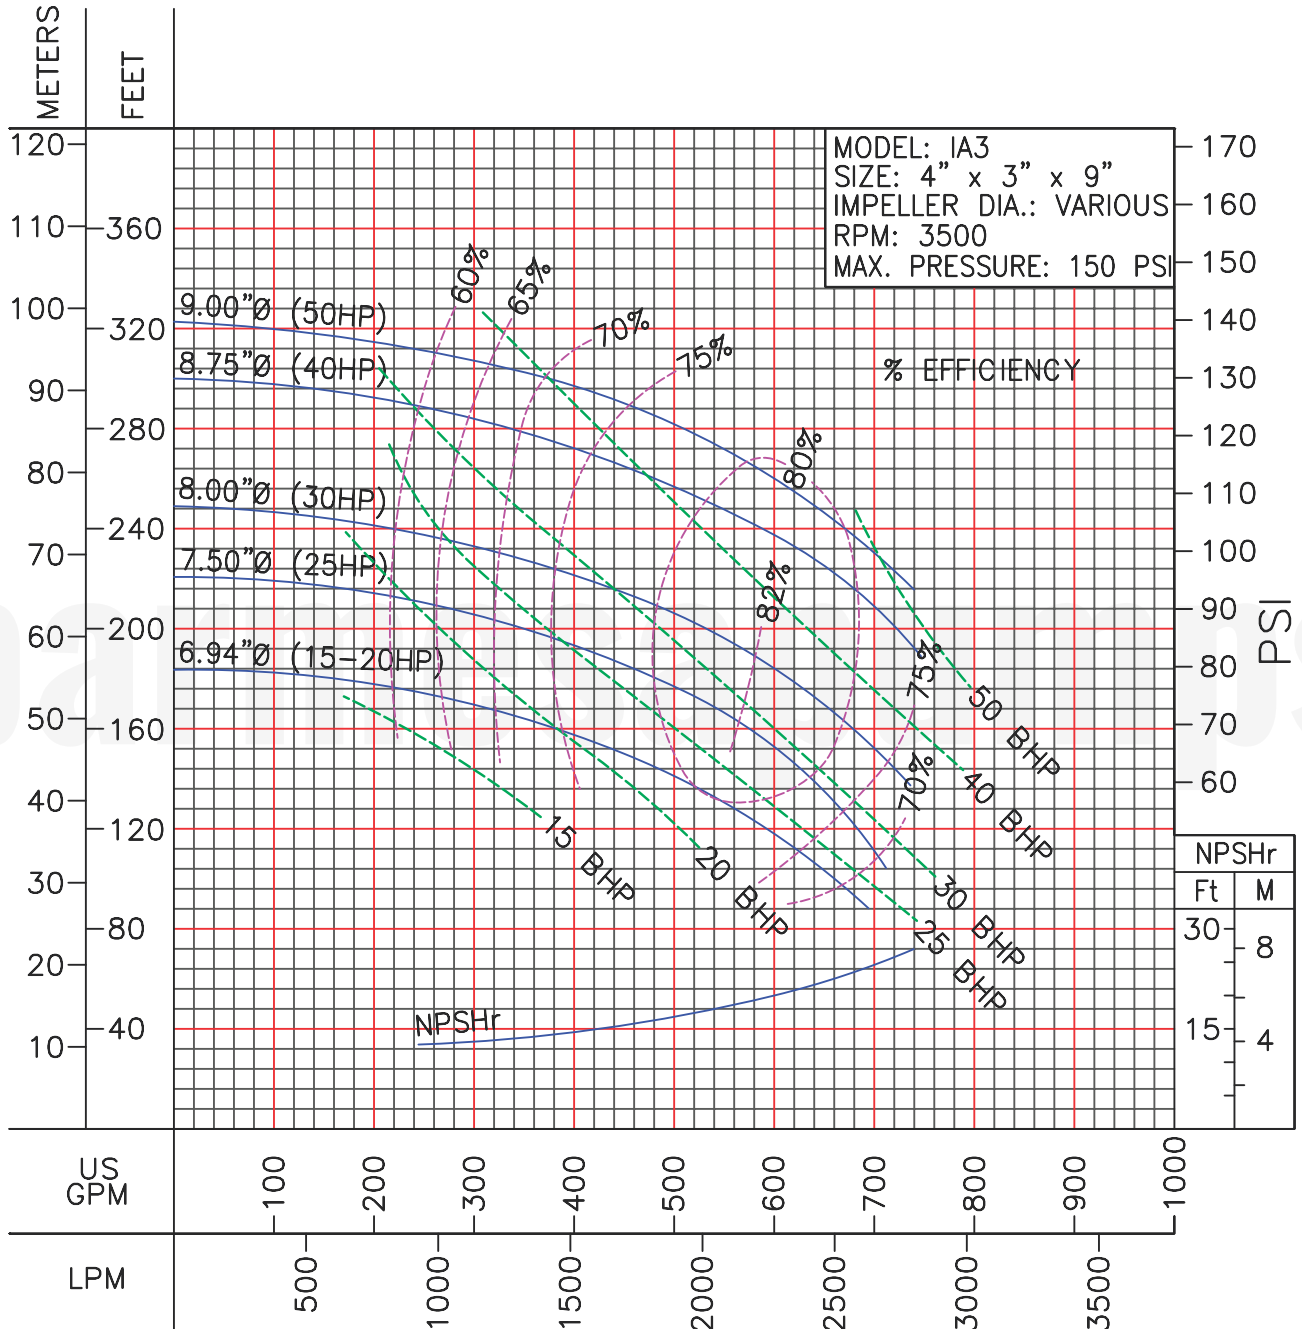


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68°F (20°C); other fluids may vary performance.

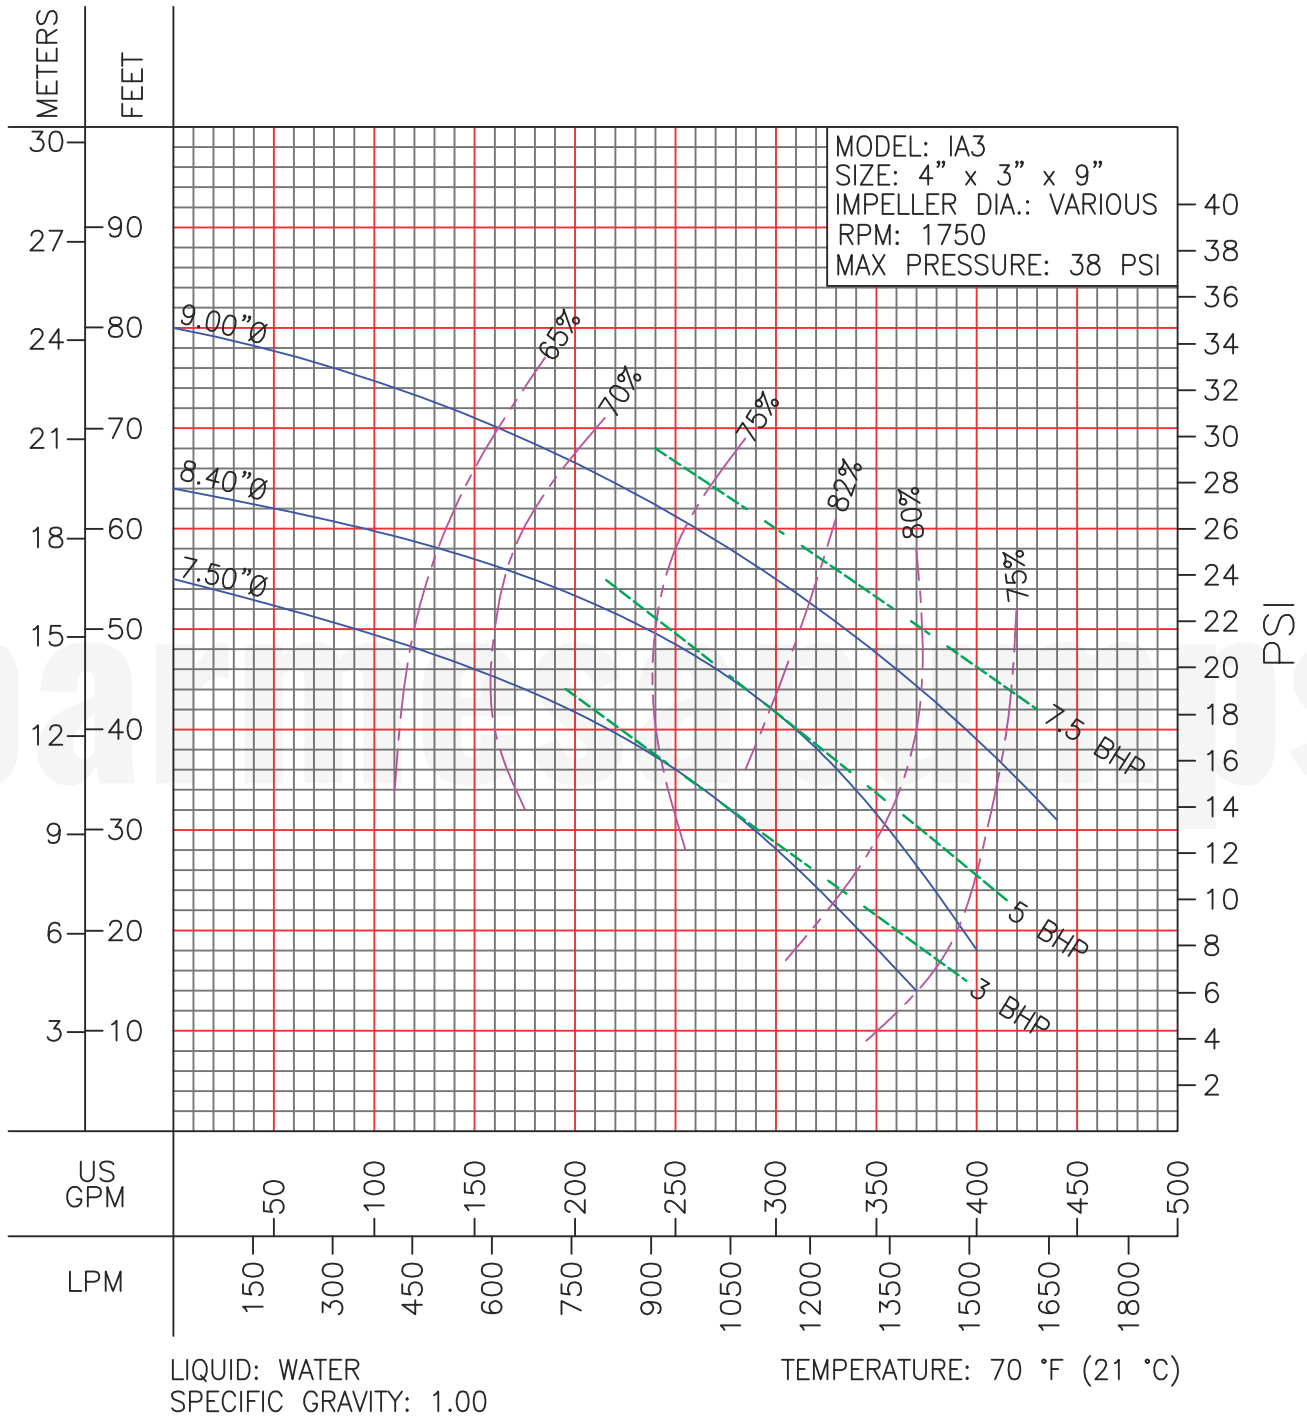


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

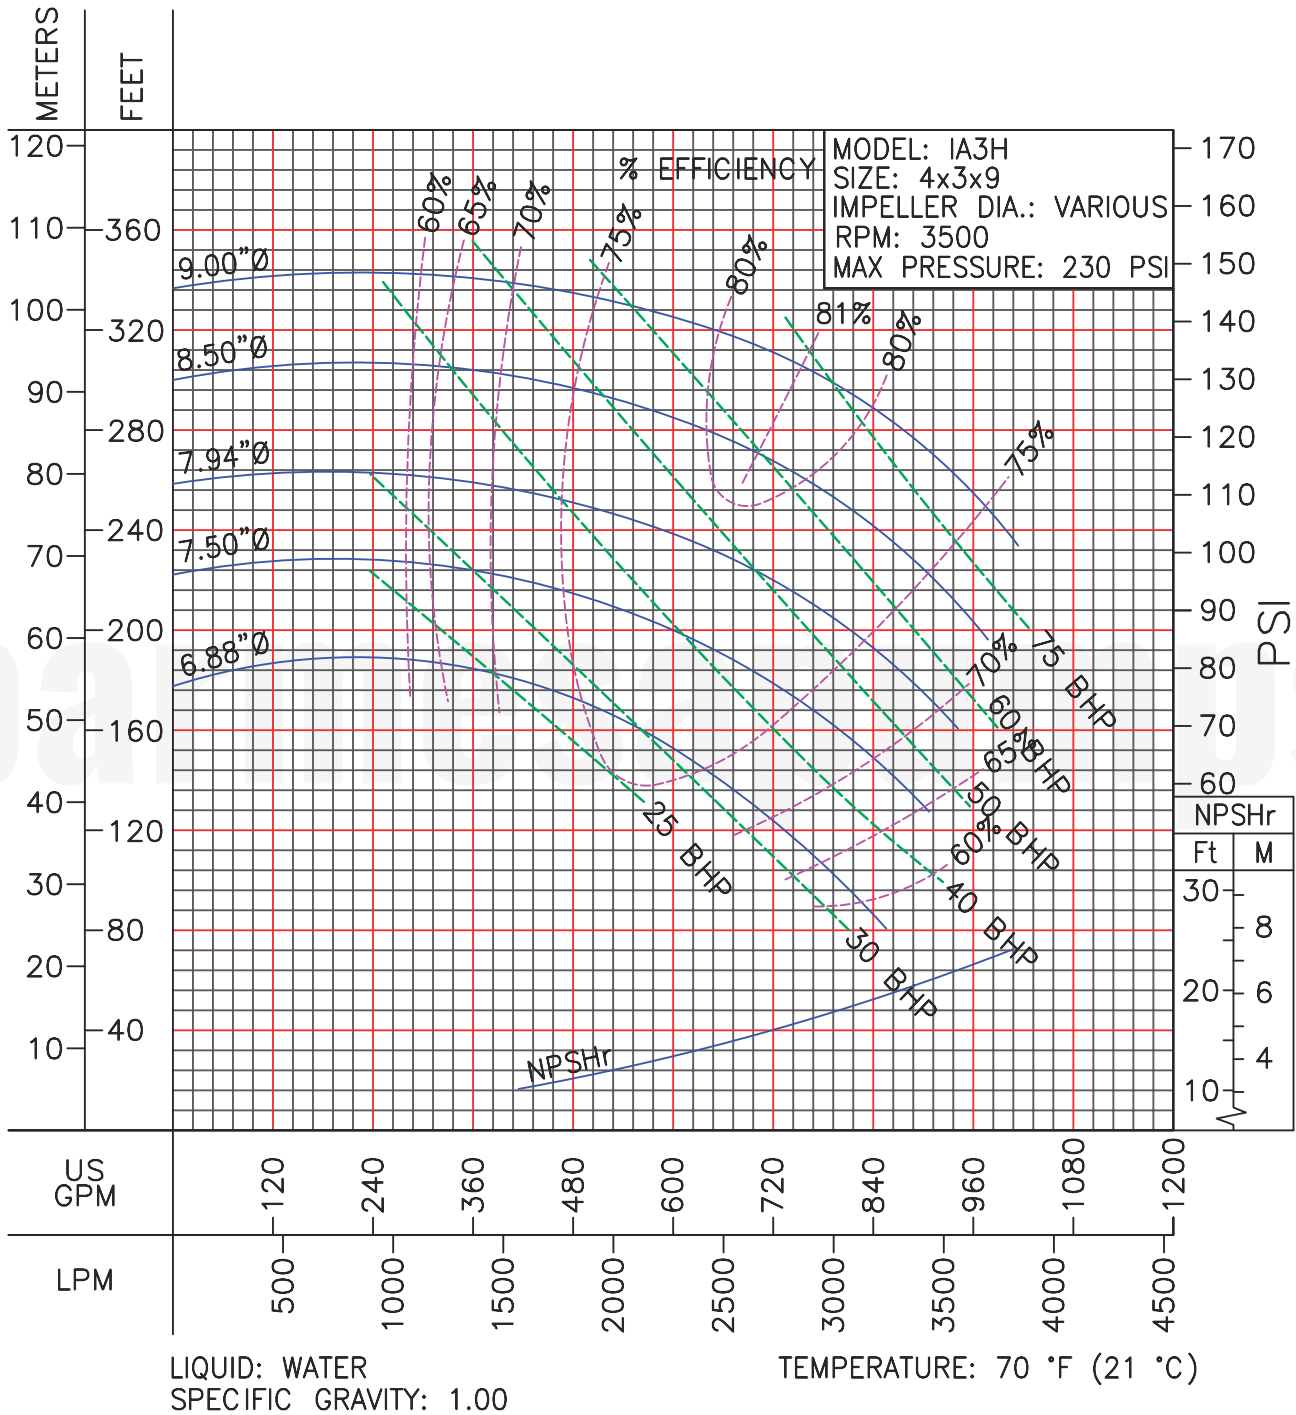


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

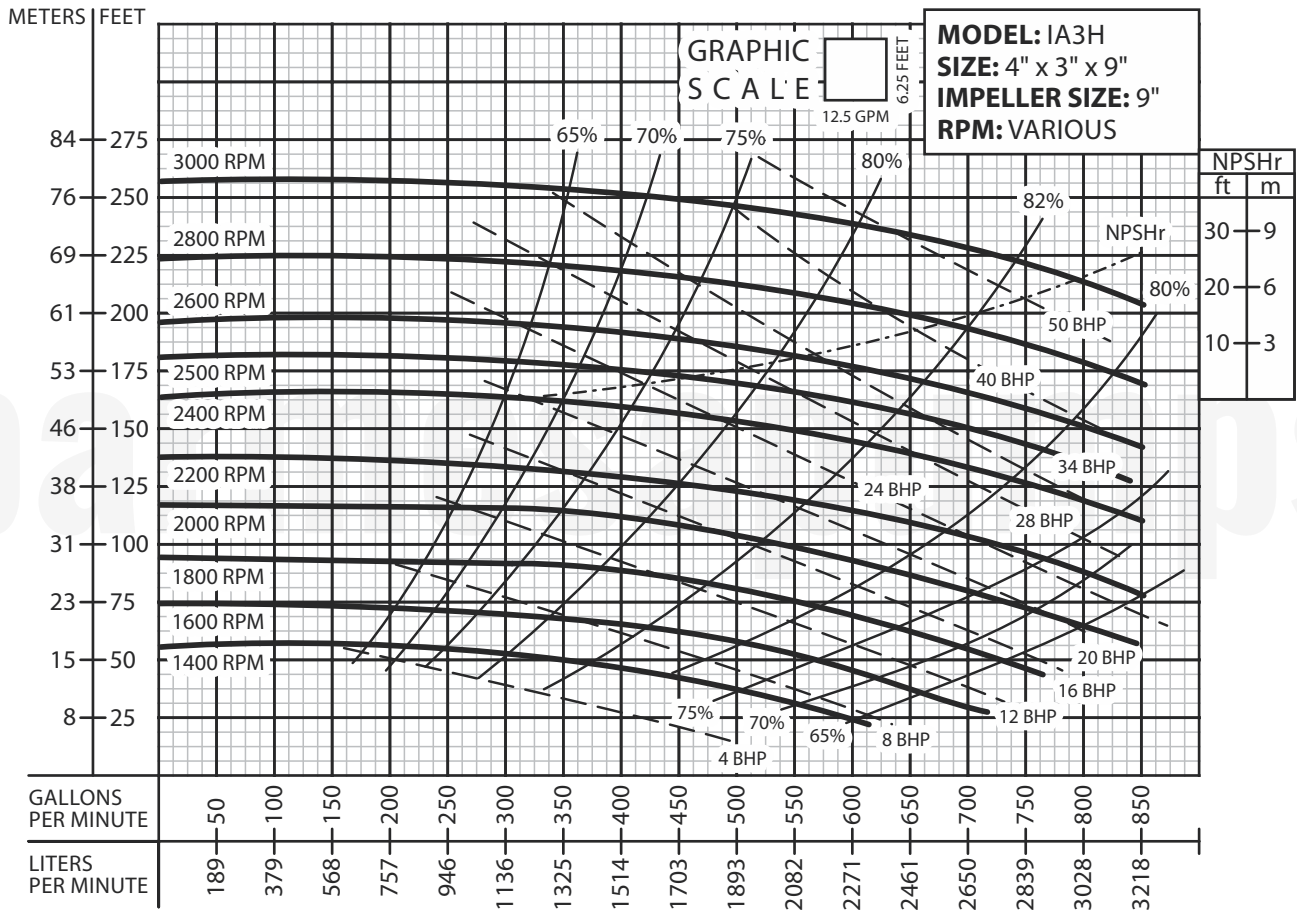

IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

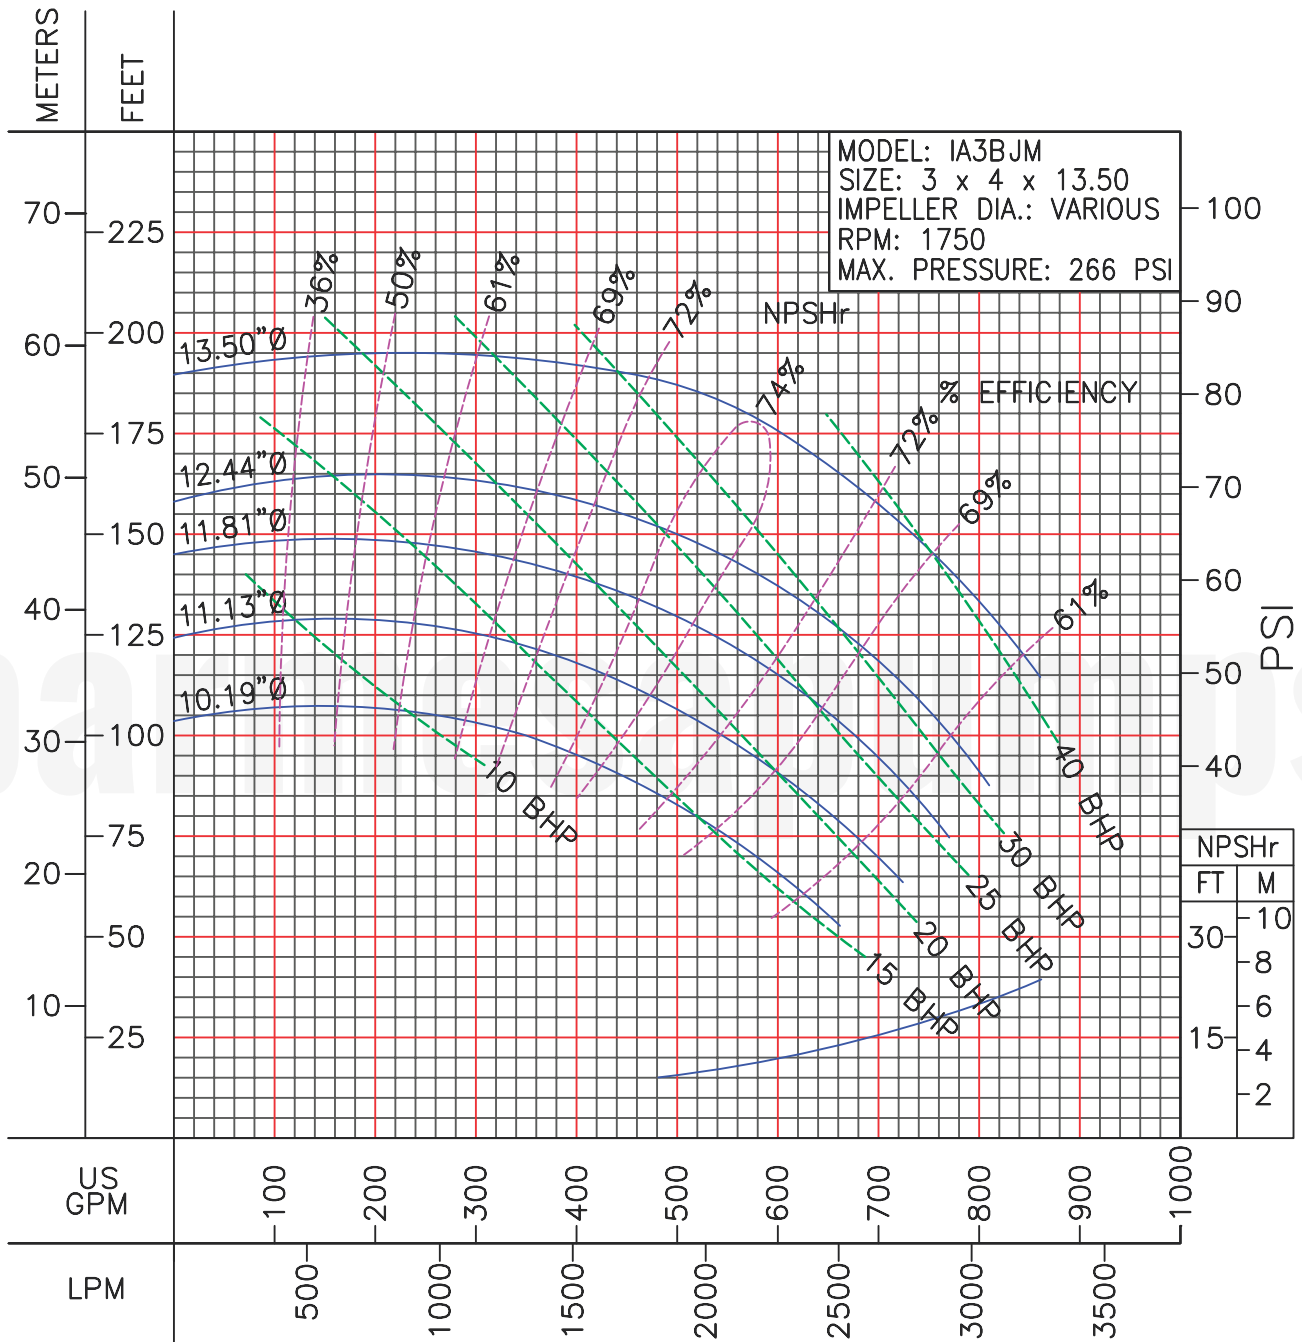


LIQUID: WATER
 SPECIFIC GRAVITY: 1.00

TEMPERATURE: 70 °F (21 °C)


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

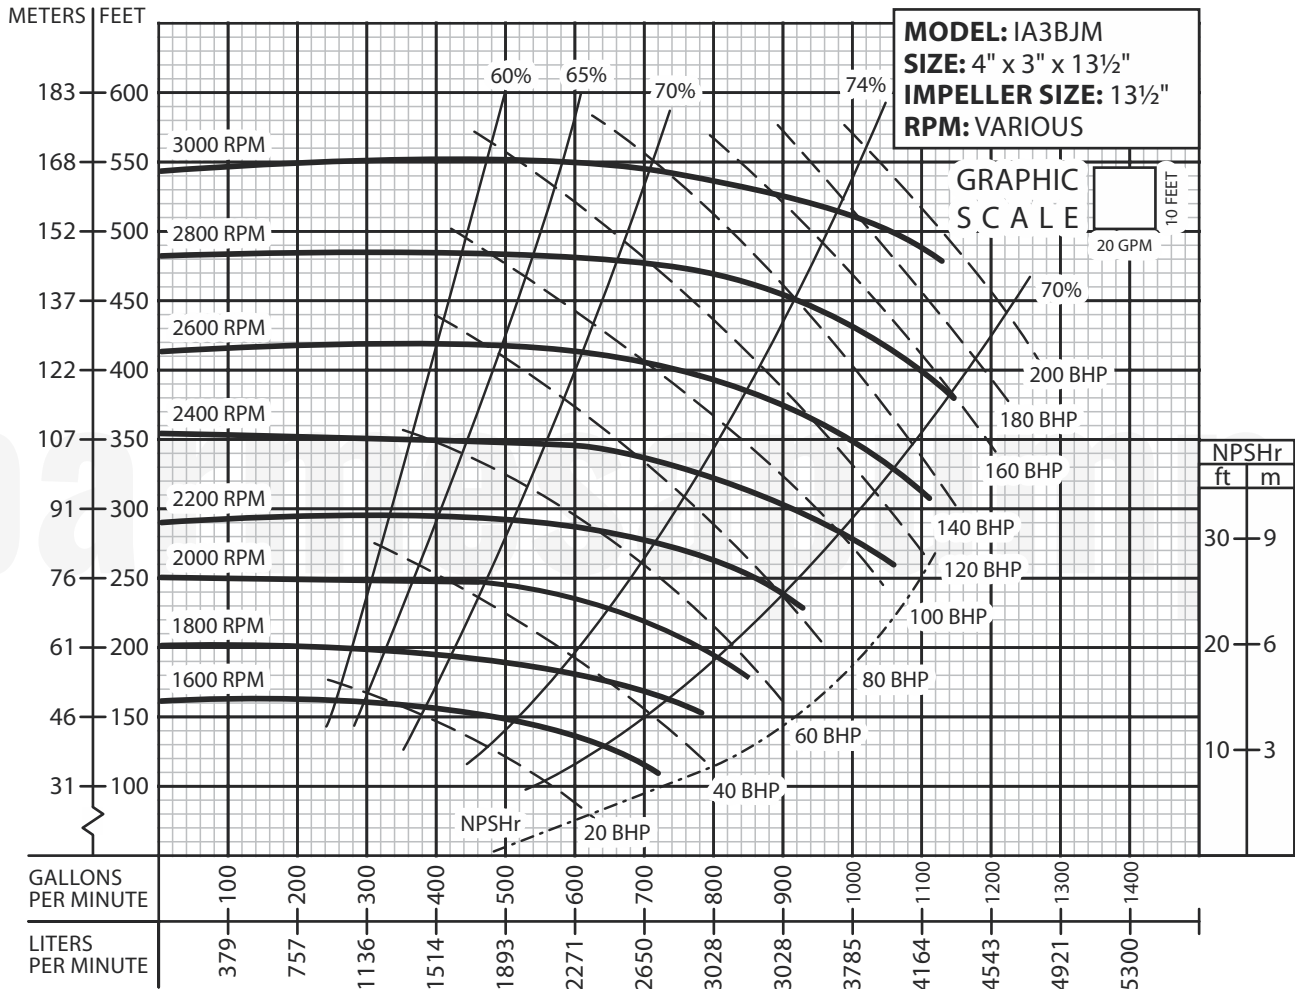


IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

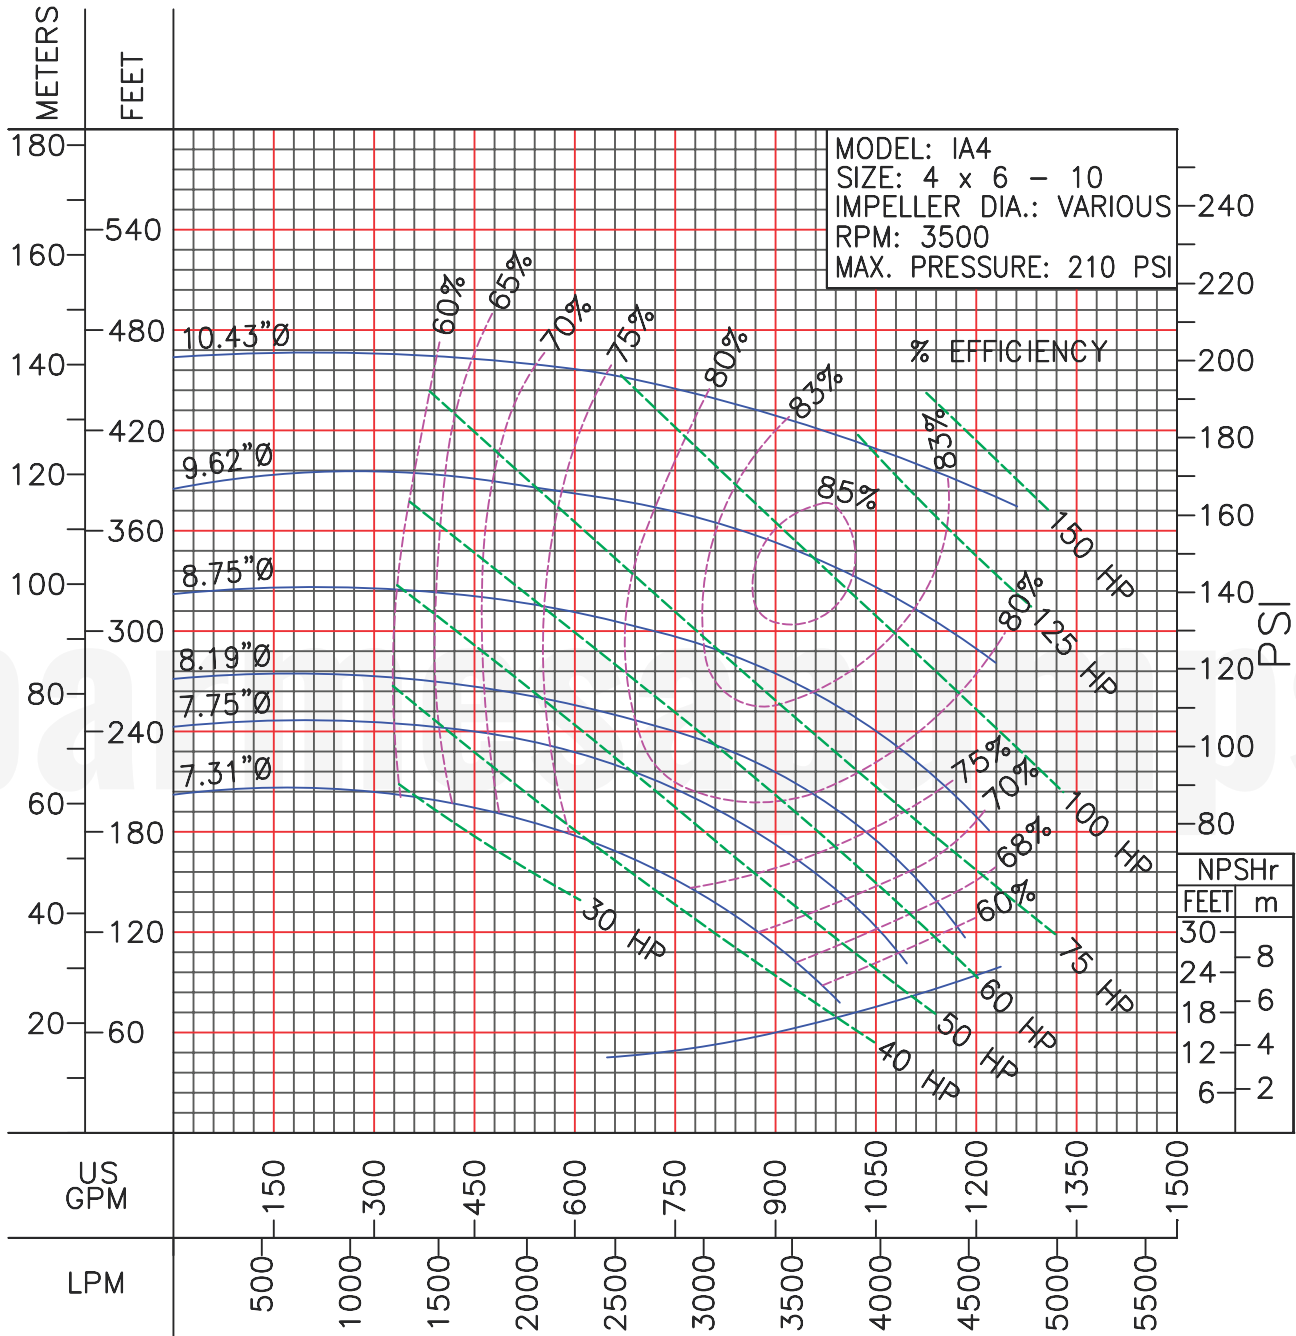

LIQUID: WATER
 SPECIFIC GRAVITY: 1.00

TEMPERATURE: 70 °F (21 °C)

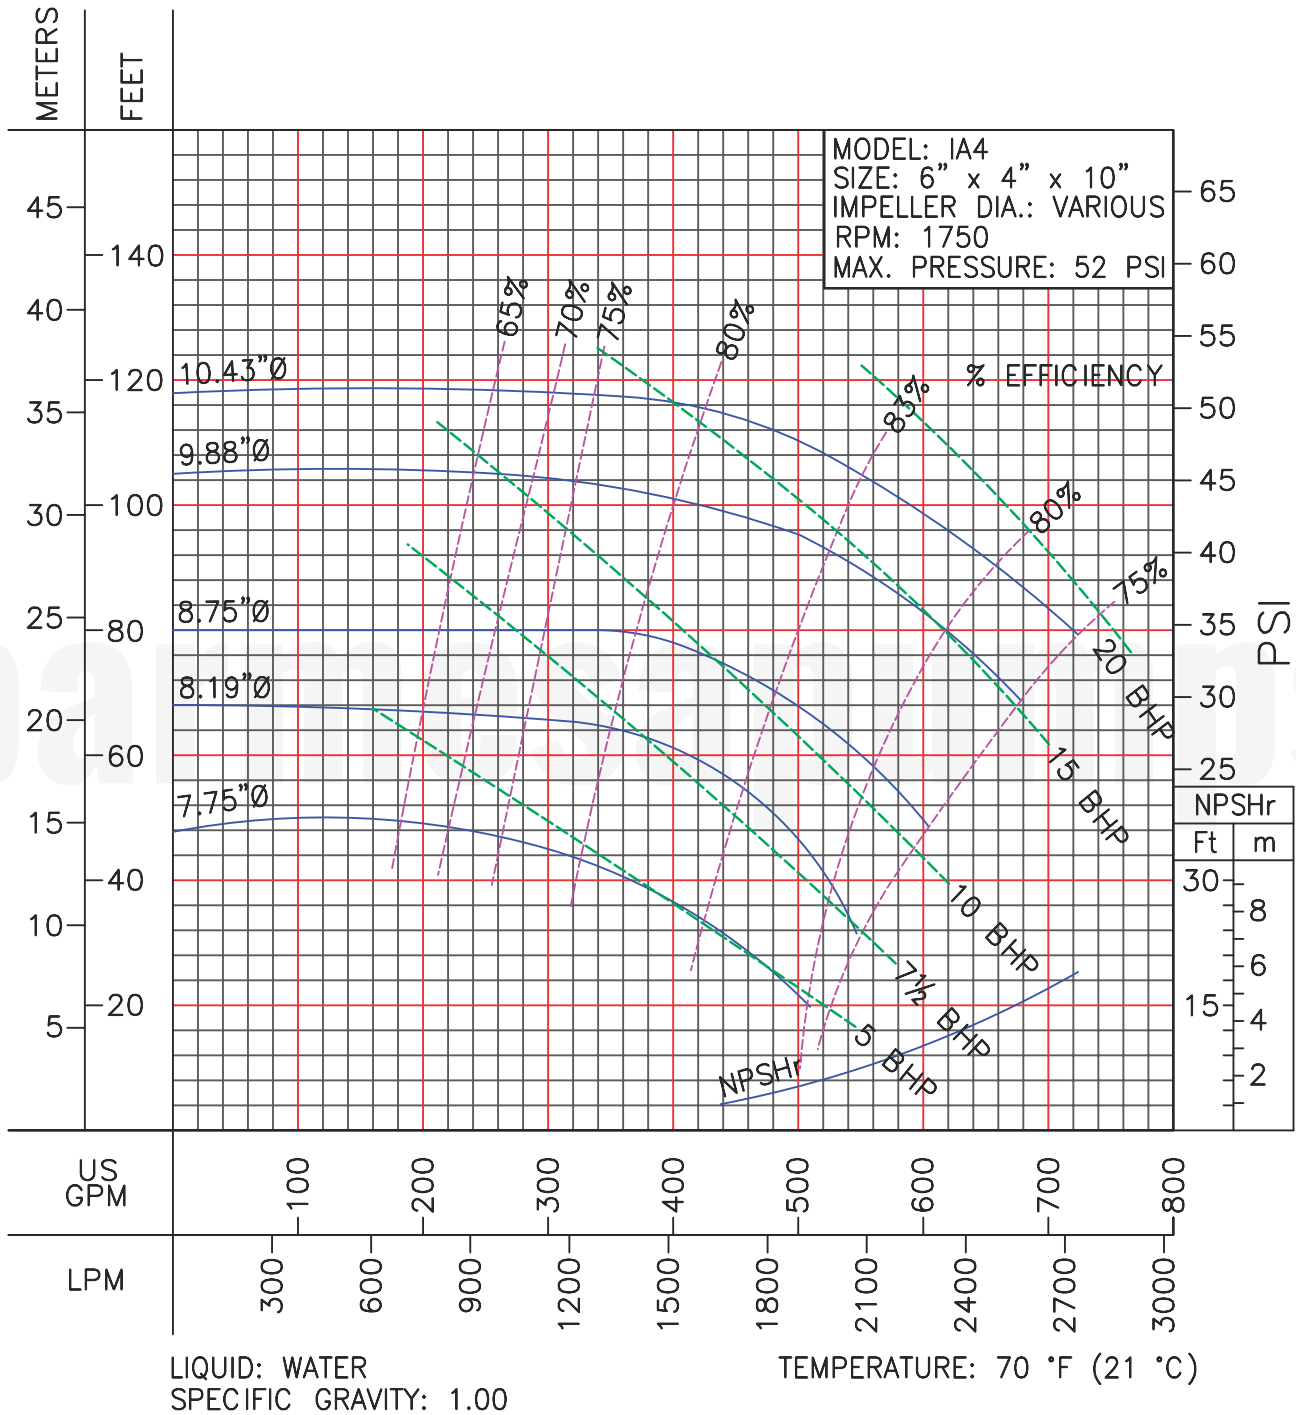

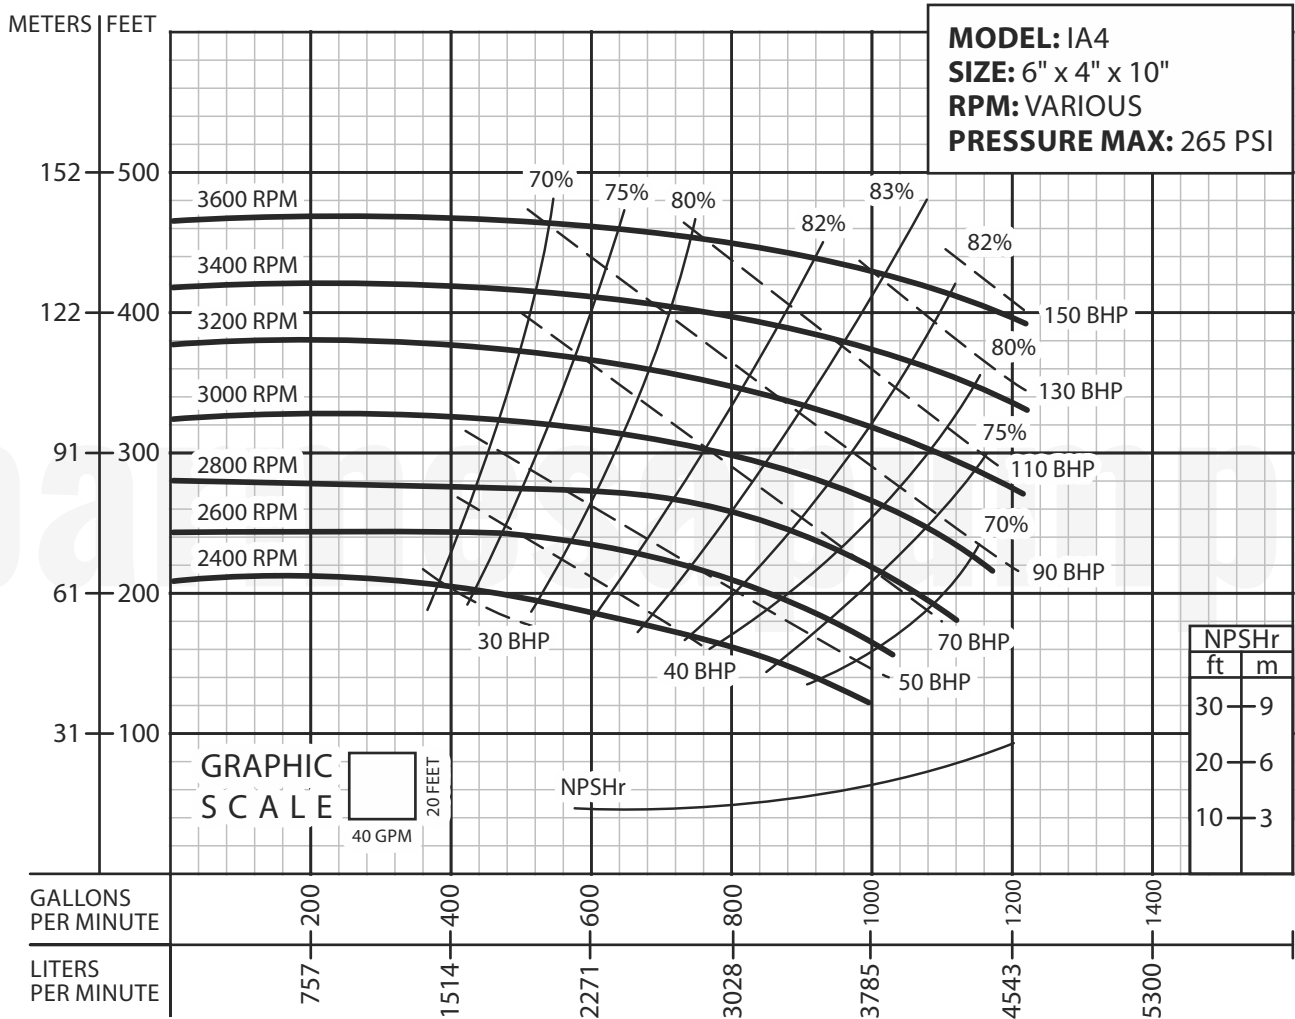


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

MODEL: **IA4BU**


RPM: 1750

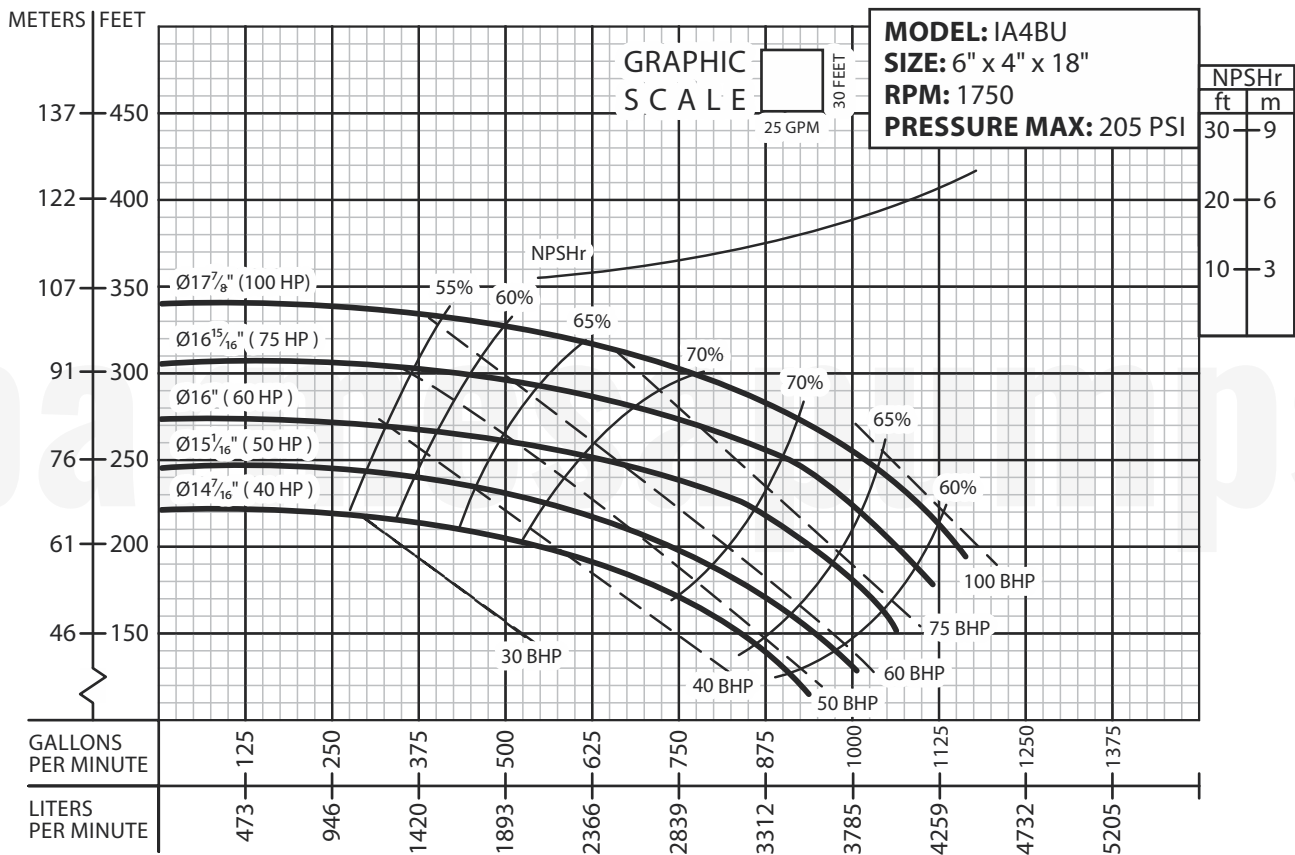

IMPORTANT!


1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

barmesapumps.com/US

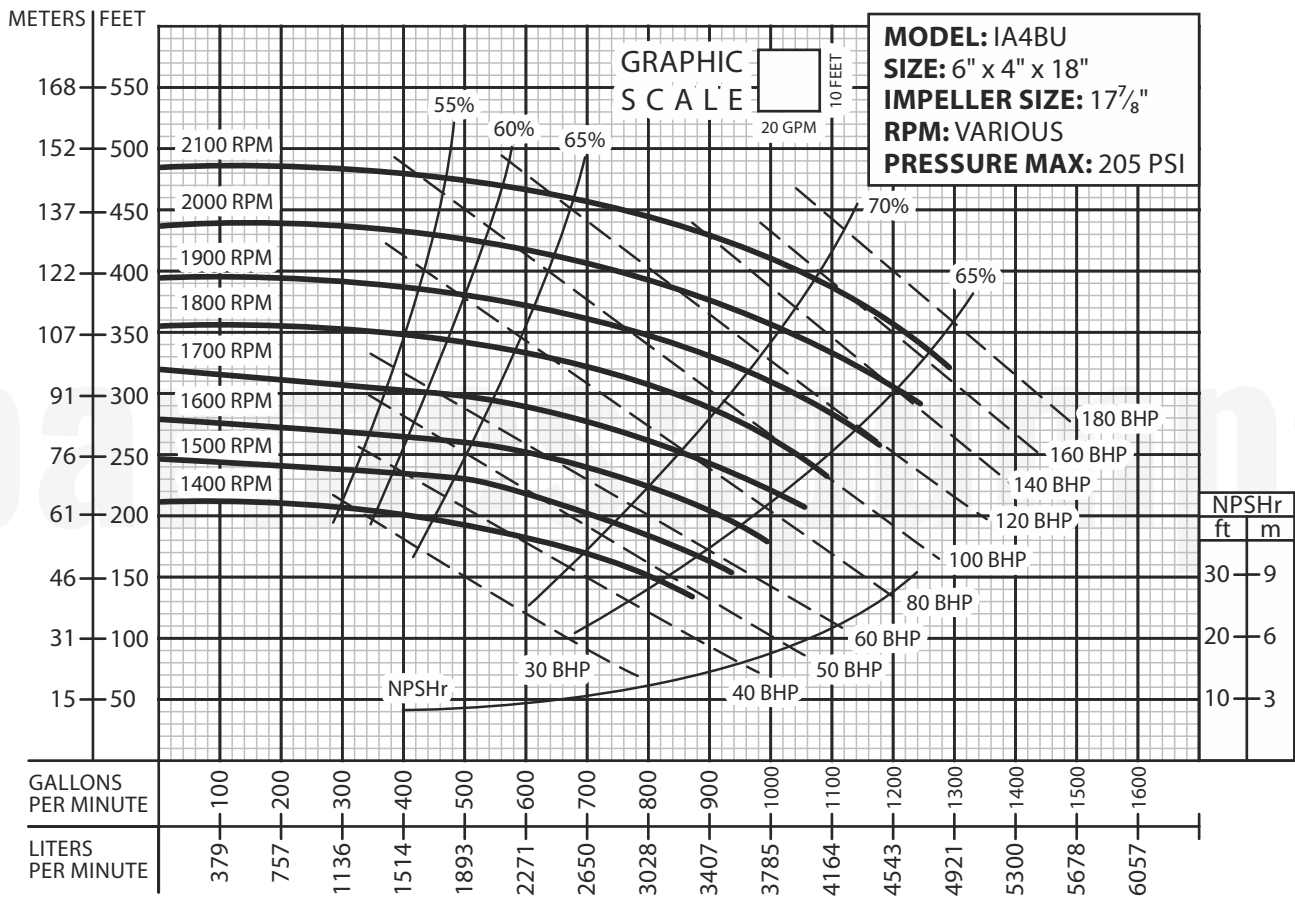


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

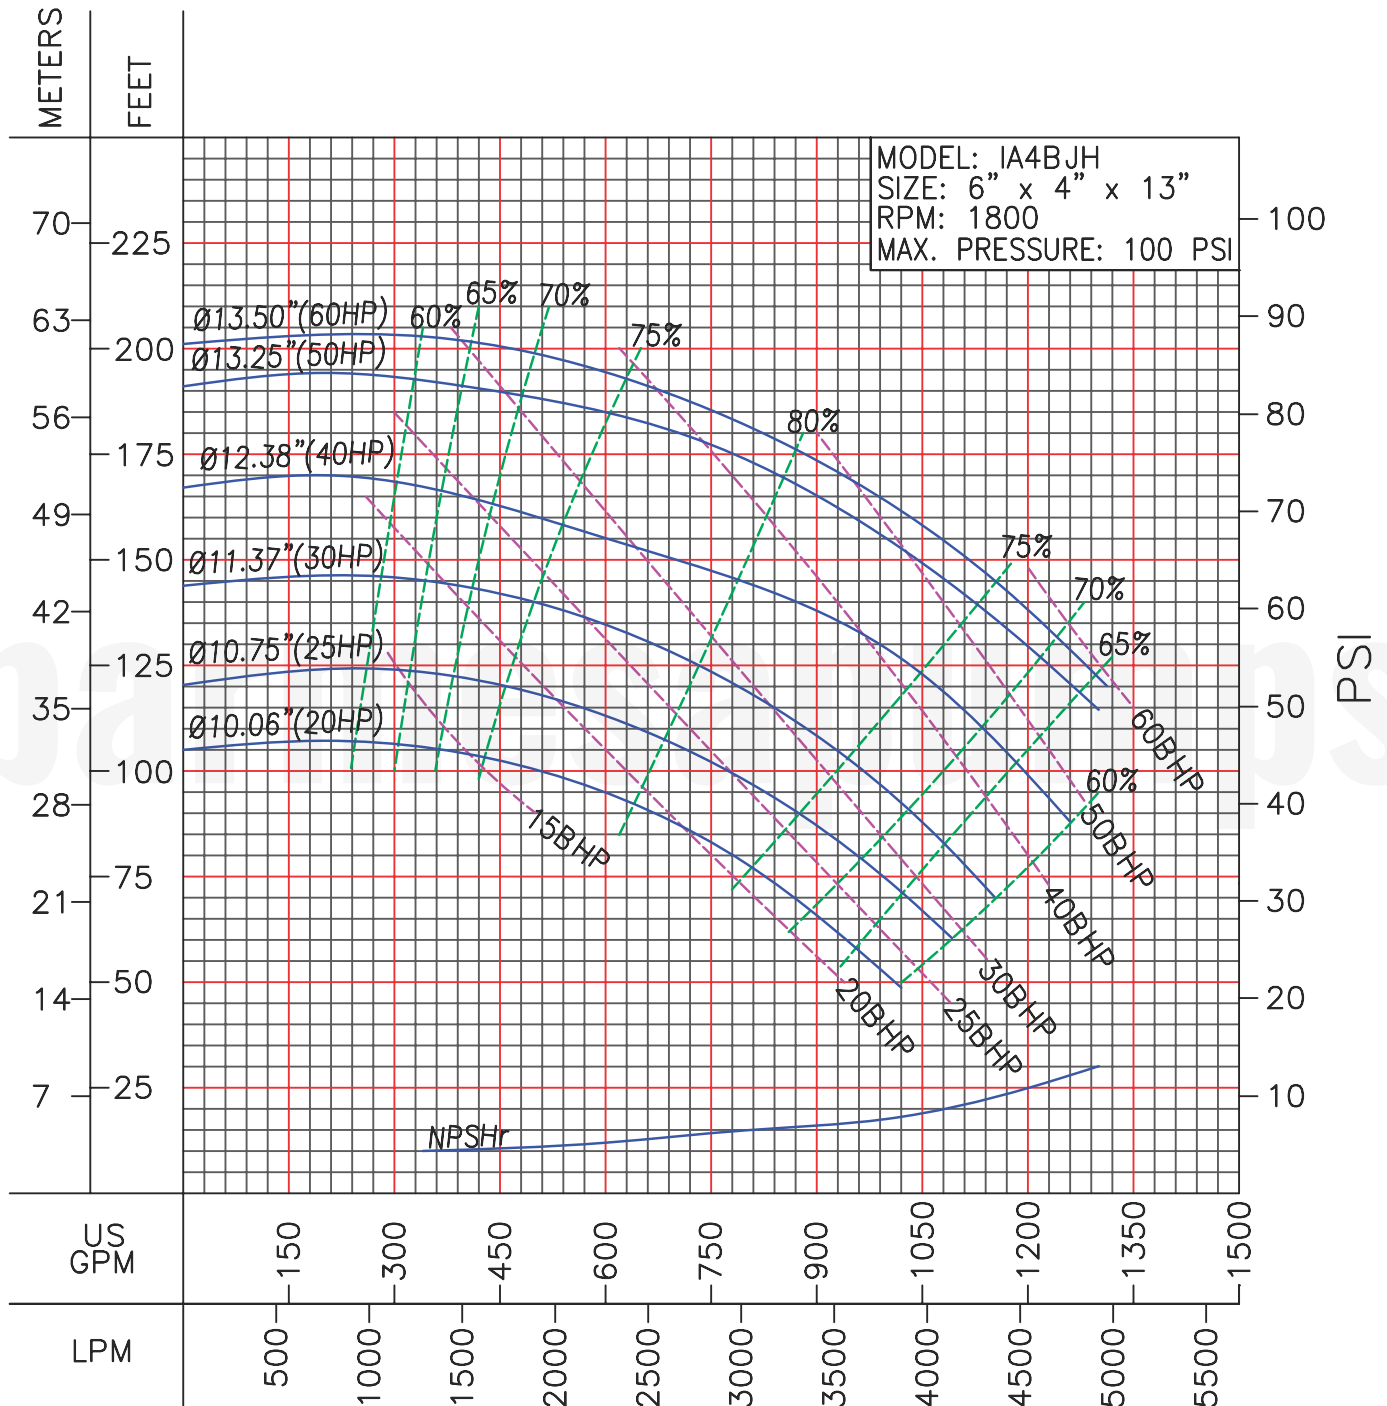


IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

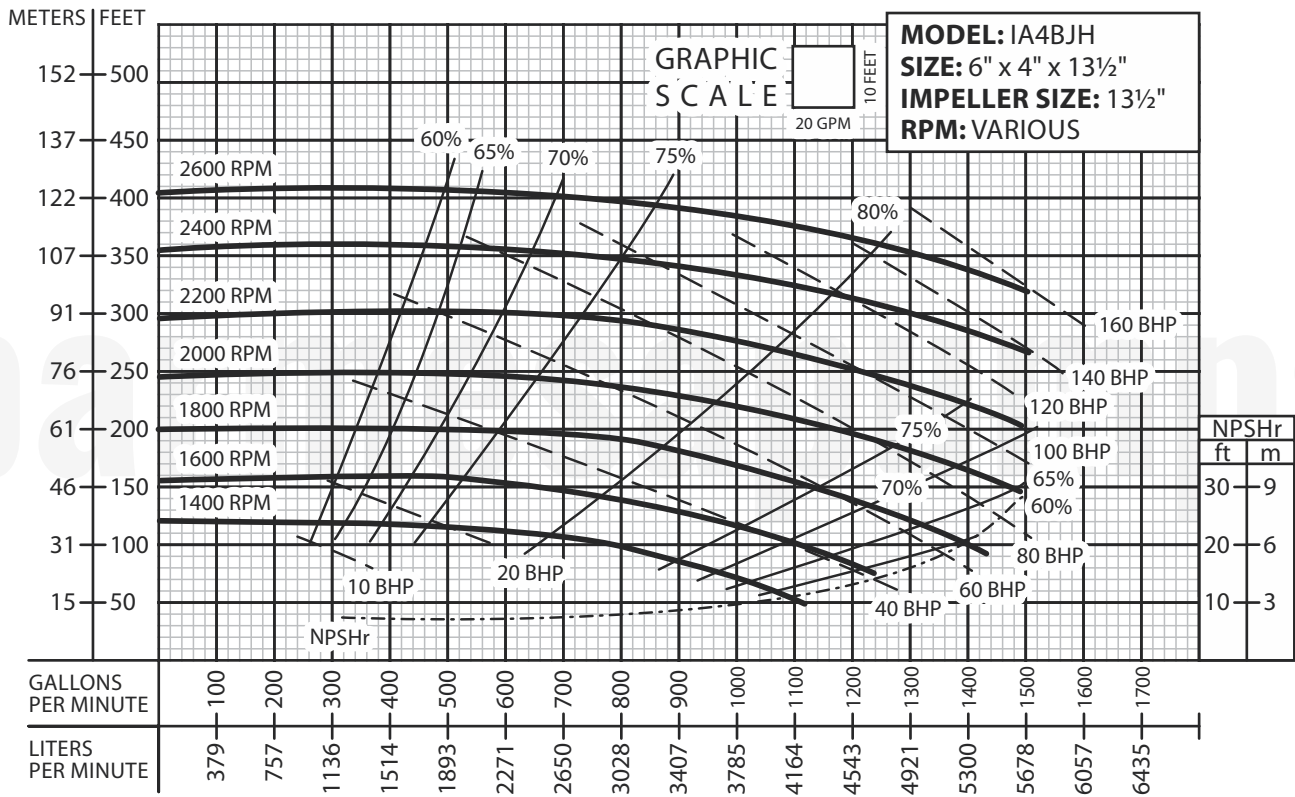

IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

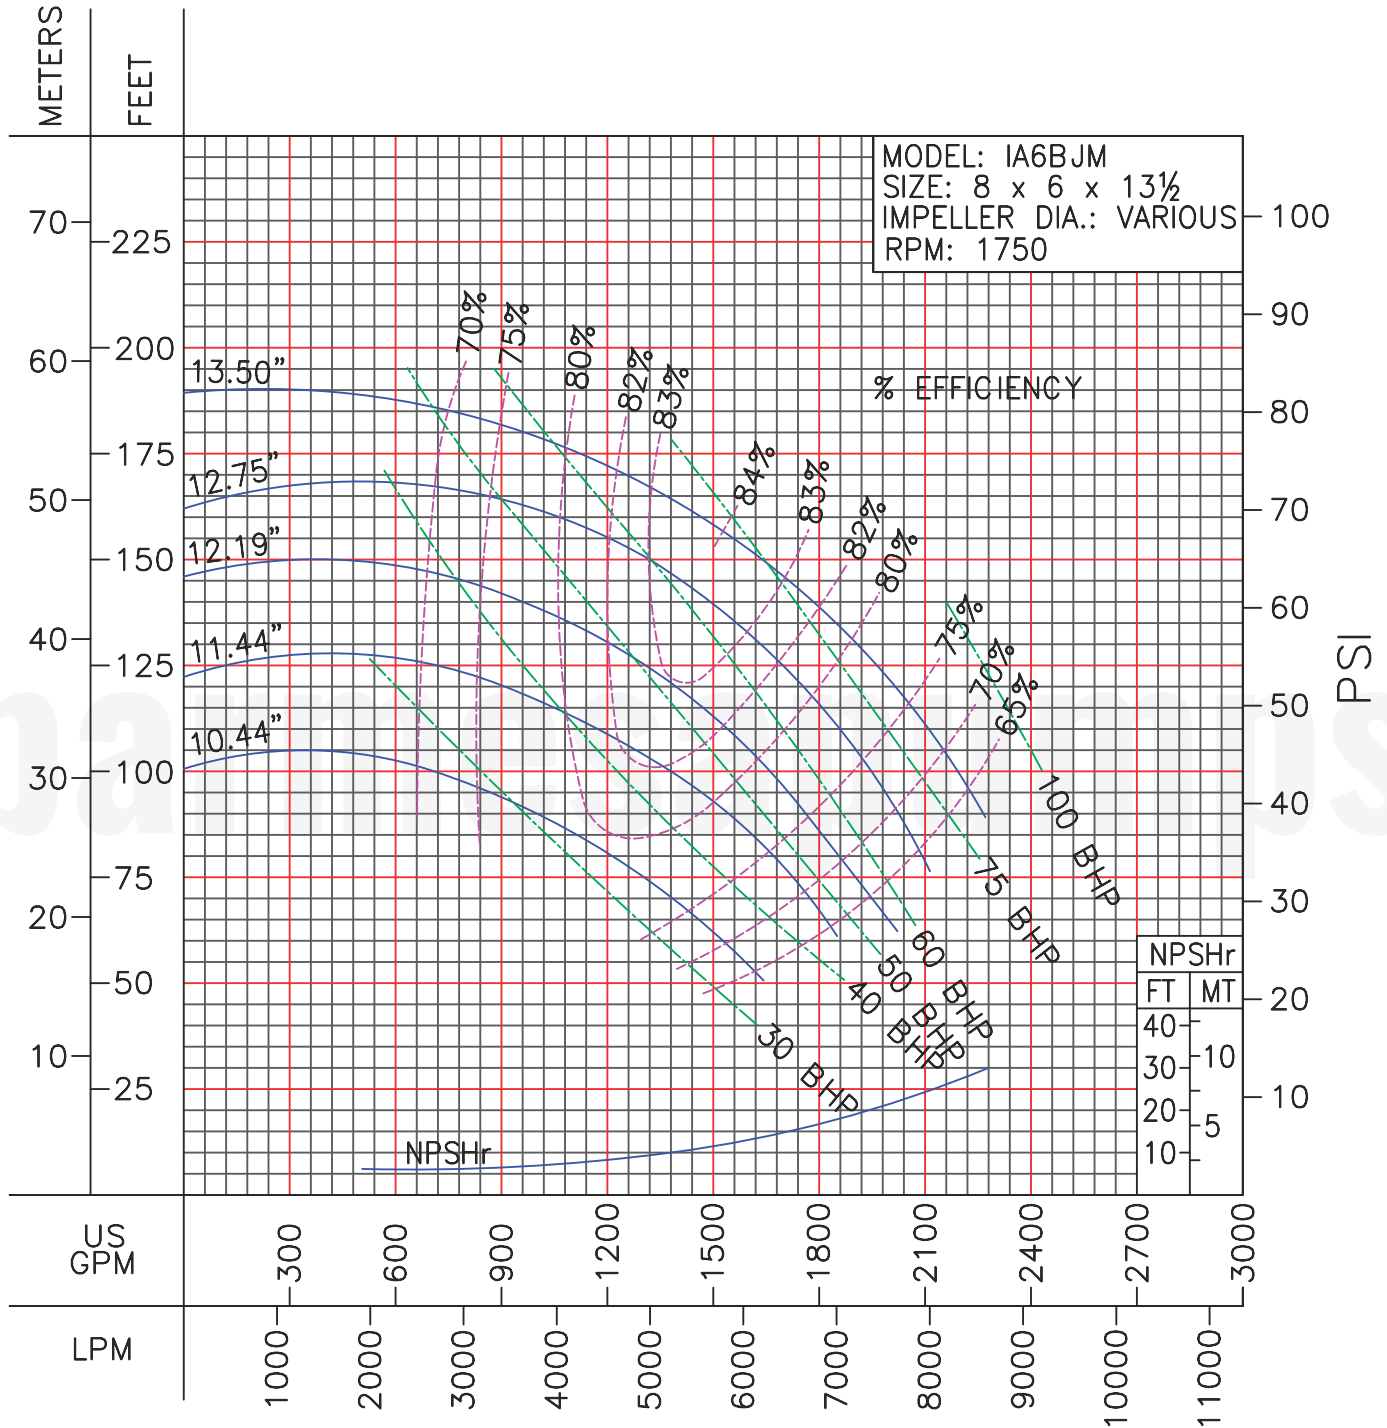


LIQUID: WATER
SPECIFIC GRAVITY: 1.00

TEMPERATURE: 70 °F (21 °C)

IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

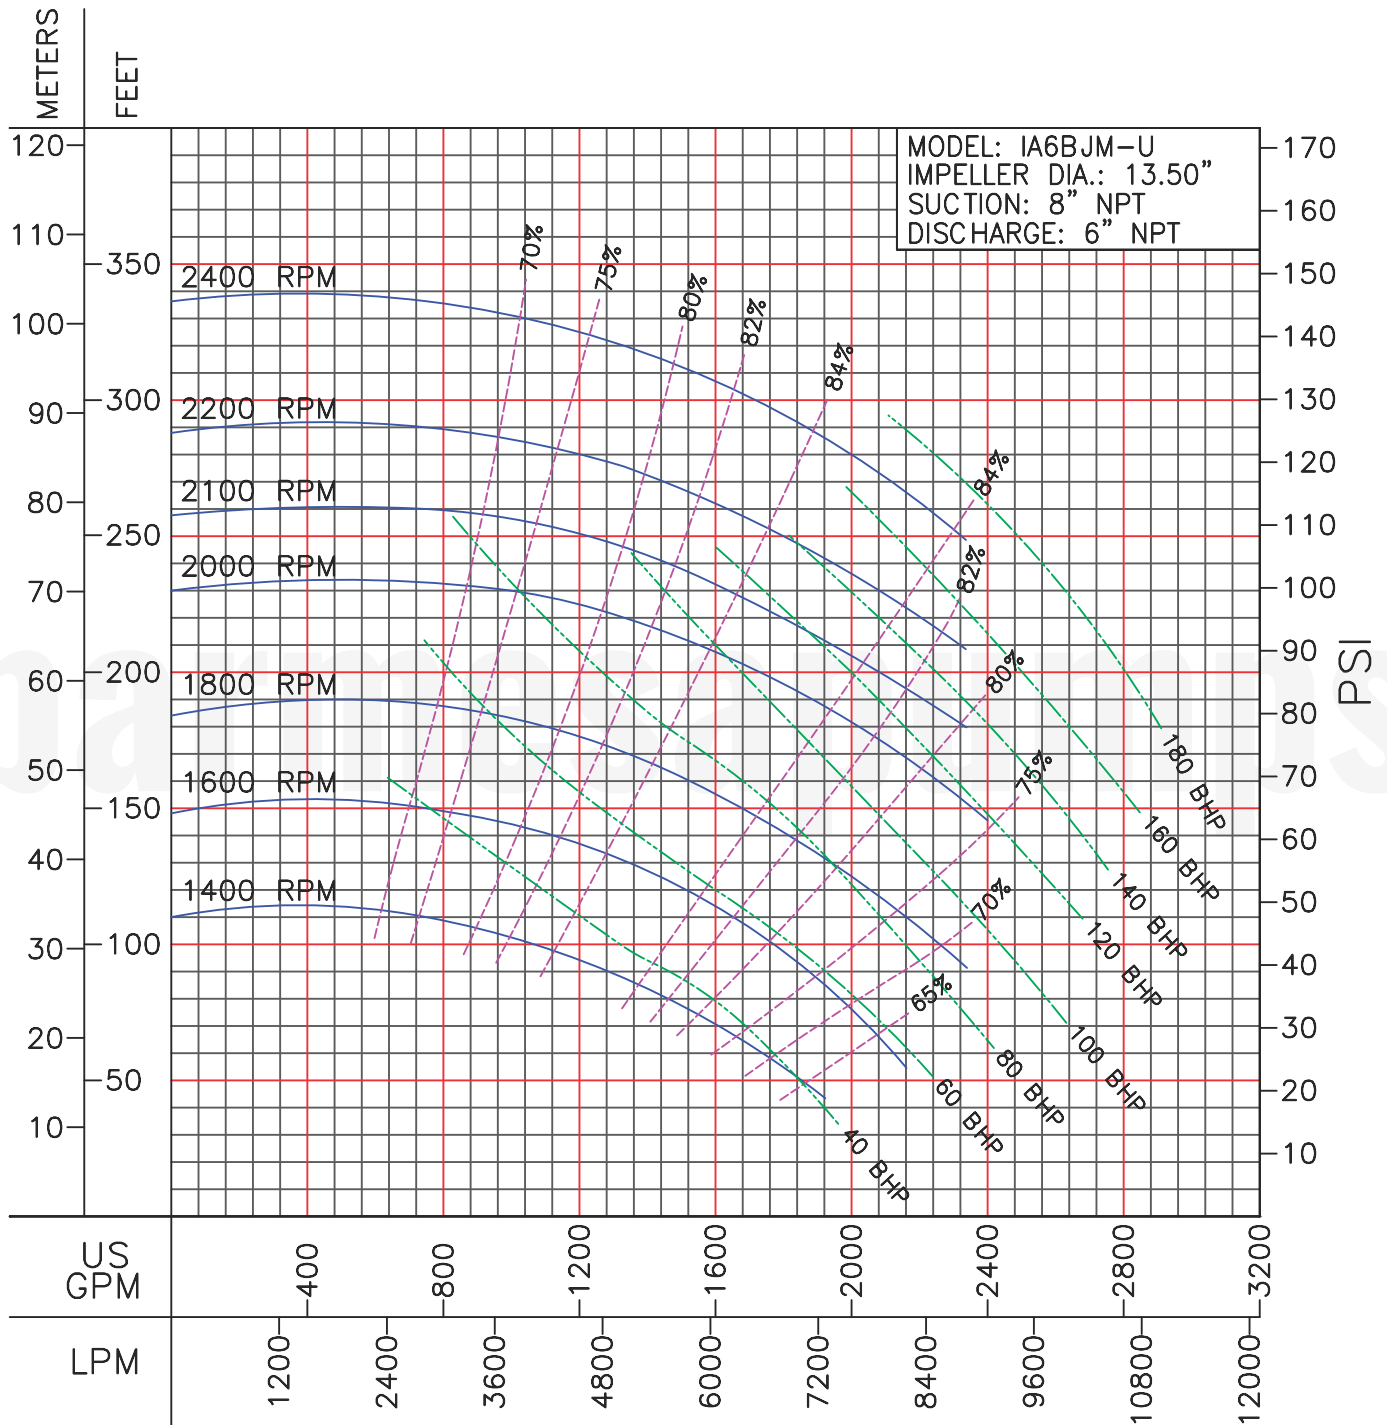

IMPORTANT!

1. Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

